

- $\langle \mathsf{A} \rangle$ REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.
- (B) ALL DIMENSIONS TO ROUGH FACE OF ROUGH FRAMING, CONCRETE, MASONRY OR CENTERLINE OF STRUCTURE, UNLESS OTHERWISE NOTED. COLD FORM METAL STUD INTERIOR PARTITION DIMENSIONS 3-5/8" UNLESS OTHERWISE INDICATED AND NOT SHOWN FOR
- © REFER TO EXTERIOR AND INTERIOR FINISH SCHEDULES FOR ADDITIONAL REQUIREMENTS.
- D REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS FOR ADDITIONAL REQUIREMENTS. NOTIFY ARCHITECT IF FINAL DESIGN CONDITIONS DEVIATE SUBSTANTIALLY FROM THOSE INDICATED HEREIN.

KEY NOTES

- (1) CONCEALED STEEL COLUMN, REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS. PROVIDE SHEET METAL COVER WITH NO EXPOSED HORIZONTAL SEAMS. FINISH TO MATCH WINDOW
- 2 EXPOSED STEEL COLUMN, REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS, (PAINT).
- $\langle 3 \rangle$ NOT USED
- 4 PORTABLE FIRE EXTINGUISHER SURFACE MOUNTED AT 42" A.F.F. TO CENTERLINE OF EXTINGUISHER. FIRE EXTINGUISHERS SHALL BE UL LISTED, ABC TYPE, WITH 10 LBS. CAPACITY.
- (5) SHOWROOM CORNER WALL BOX OUT. INSTALL 5/8" FIRE TREATED PLYWOOD BACKING TO BACK SIDE OF STUD INTERIOR FLANGE ON EACH EXPOSED WALL FACE FROM 8'-0" TO 10'-0" A.F.F. FOR INSTALLATION OF SECURITY MIRRORS. REFER TO 4/A4.2 (TYPICAL).
- 6 TACTILE EXIT SIGN AT EXIT DISCHARGE DOOR STATING "EXIT" WITH BRAILLE LETTERING. SIGN TYPE TO COMPLY WITH ANSI A117.1 AND MOUNTED AT 60" A.F.F. TO CENTERLINE.
- T STEEL COLUMN. PROVIDE 7/8" COLD FORM FURRING (20 GA.) OR FIRE TREATED 2X NAILERS AT 24" O.C. WITH 5/8" TYPE "X" GYPSUM BOARD. HOLD TIGHT AND PLUMB WITH COLUMN.

ARCHITECT OF RECORD

ADAM KREHER ARCHITECT LICENSE NUMBER AR98768

SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

8 ROOF ACCESS LADDER AND HATCH ABOVE.

INTERIOR WALL & CEILING NOTES

1. GENERAL:
A. REFER TO FINISH SCHEDULES FOR ADDITIONAL WALL FINISH MATERIAL APPLICATIONS.

B. REFER TO WALL SECTIONS AND DETAILS FOR ADDITIONAL CONDITIONS.

A. PROVIDE FIRE TREATED 2X BLOCKING AS REQUIRED FOR INSTALLATION OF ACCESSORIES PER MANUFACTURER'S RECOMMENDATIONS.

B. PROVIDE DIAGONAL WALL BRACING (3" X 16 GA. FLAT STRIP) AT CORNER FACES OF FREE STANDING PARTITION SYSTEMS.

C. WHERE WALL FRAMING EXTENDS TO BOTTOM OF ROOF DECK OR STRUCTURE, PROVIDE DEFLECTION CHANNELS AT TOP TRACK FOR 1 1/2" MINIMUM DEFLECTION.

D. REFER TO STRUCTURAL DRAWINGS FOR STRUCTURAL STUD

E. REFER TO WINDOW AND DOOR HEAD, JAMB AND SILL DETAILS FOR ADDITIONAL FRAMING REQUIREMENTS.

F. PROVIDE HORIZONTAL STUD BRIDGING AT 4'-0" O.C. VERTICAL.

3. GYPSUM AND BACKING BOARD:

A. EXPANSION/CONTROL JOINTS: INSTALL EXPANSION/CONTROL JOINTS IN CEILINGS EXCEEDING 2500 SQ. FT. IN AREA AND IN PARTITION WALL LENGTHS EXCEEDING 30 FEET. DO NOT EXCEED A DISTANCE OF 50 FEET IN ANY DIRECTION BETWEEN CEILING JOINTS. INSTALL CONTROL JOINTS WHERE FRAMING OR FURRING CHANGES DIRECTION.

B. PROVIDE MOISTURE RESISTANT TYPE "X" GYPSUM BOARD AT ALL WET LOCATIONS (RESTROOMS, WET WALLS, AND JANITOR'S SINK AREAS).

C. PROVIDE "J" MOLDING, REGLETS, OR CORNER BEAD AT GYPSUM BOARD PERIMETER CONDITIONS TRANSITIONING TO DISSIMILAR EXPOSED FINISH MATERIALS.

4. INSULATION:
A. INSULATION SHALL HAVE A FLAME SPREAD RATING OF 0-25 AND A SMOKE DEVELOPMENT RATING OF 0- 450.


B. PROVIDE SEALANT ON BOTH SIDES OF STUD BOTTOM TRACKS AT ACOUSTICAL INSULATED WALL LOCATIONS.

5. FIRE STOPPING: A. PROVIDE FIRE STOPPING AND FIRE SEALANT MATERIALS AS REQUIRE AT ALL FIRE RATED ASSEMBLY TRANSITIONS, PENETRATIONS, AND PERIMETER CONDITIONS. RATING TO BE EQUAL TO RATED ASSEMBLY.



KR

JUNE 15, 2018

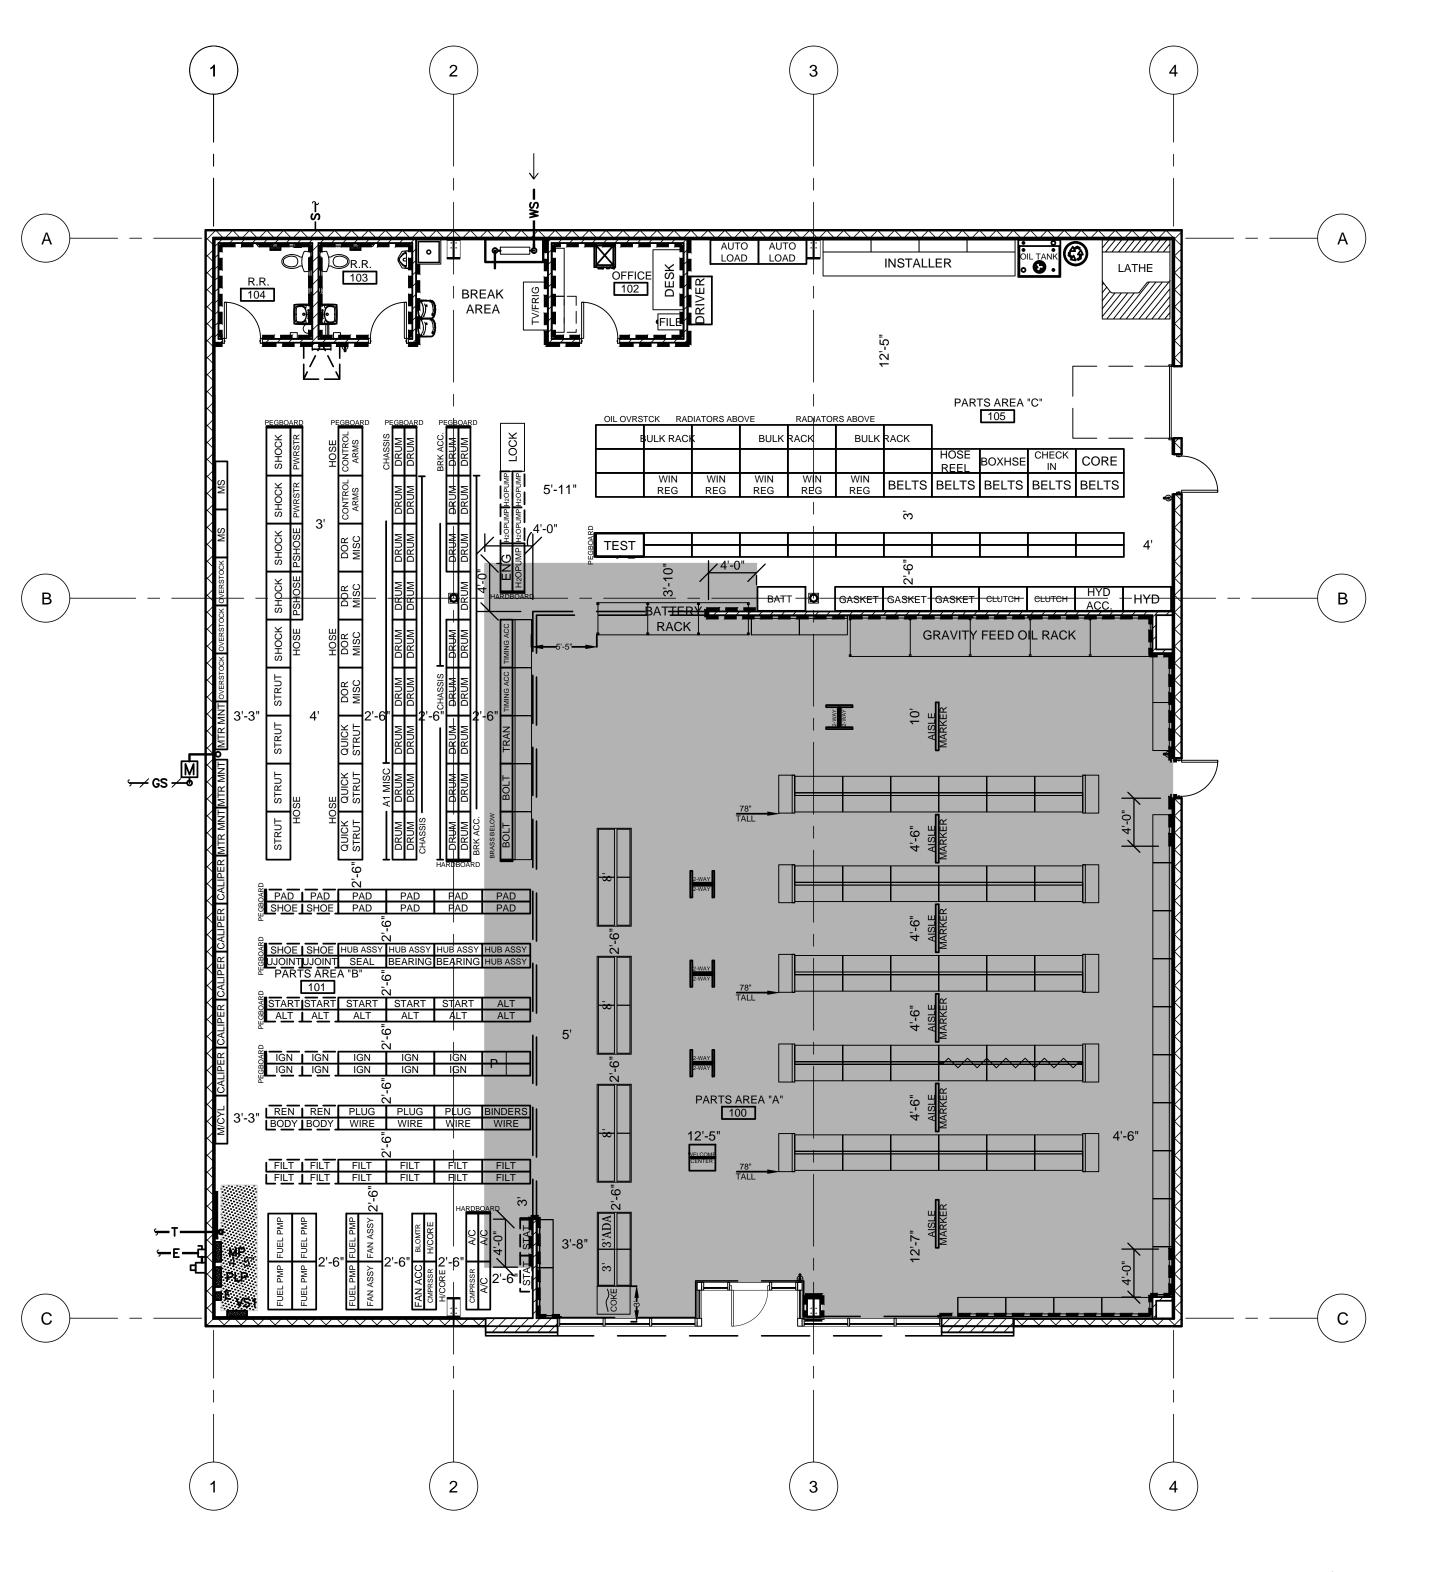

FINISH PLAN

A1.2 | SCALE: 1/8" = 1'-0"

	INTERIOR FINISH SCHEDULE													
10	ROOM OR SPACE	FLOORING		WALLS			CEILING		DOORS		NOTES	INTERIOR FINISH SCHEDULE NOTES:		
IO.		TYPE	BASE	NORTH	EAST	SOUTH	WEST	TYPE	HEIGHT	DOOR	FRAME		1. PAINT EXTERIOR OF (102) OFFICE, (103) RESTROOM, AND (104) RESTROOM WITH W-3 AND PROVIDE BASE B-1 MULTIPLE WALL FINISH TYPES INDICATED IN SCHEDULE RELATES TO VARIOUS WALL FINISH TYPES BY ROOM (104)	
00	PARTS AREA (A)	F-1	B-1	W-1	W-1	W-1	W-1	C-1	11'-6"	D-3	D-3	2, 4, 5	SPACE PLAN ORIENTATION ONLY AND IS NOT INTENDED AS WAINSCOT PATTERNING OF FINISHES ON A SINGLE PLANE.	
01	PARTS AREA (B)	F-2	N/A	W-2, 3	W-2	W-2	W-2	C-4	VARIES	-	-	1, 2, 3, 5		
02	OFFICE	F-2	B-1	W-2	W-2	W-2	W-2	C-2	8'-6"	D-1	D-2		2. LOCATION OF BASE GRAPHICALLY INDICATED ON DRAWING, REFER SYMBOLS LEGEND.	
03	REST ROOM	F-2	B-1	W-4	W-4	W-4	W-4	C-3	8'-6"	D-1	D-2		3. PROVIDE PIECES OF 2' LENGTH BASE FOR INSTALLATION AT ENDS OF PARTS AREA "B" FIXTURES FACING PAREA "A".	
04	REST ROOM	F-2	B-1	W-4	W-4	W-4	W-4	C-3	8'-6"	D-1	D-2		AREA A.	
05	PARTS AREA (C)	F-2	N/A	W-2, 3	W-2	W-2	W-2, 3	C-4	VARIES	D-3	D-3	1, 2, 5	4. REFER TO ELECTRICAL DRAWINGS FOR GRID LAYOUT.	
													5. (WHERE OCCURS) PAINT INTERIOR ISOLATED EXPOSED STRUCTURAL STEEL COLUMNS TO MATCH W-3. (UN	
													OTHERWISE INDICATED) EXPOSED EXTERIOR PERIMETER STRUCTURAL STEEL COLUMNS TO BE FACTORY PRONLY.	

GENERAL NOTES

- $\langle \mathsf{A} \rangle$ REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.
- B FIXTURES AND EQUIPMENT SHOWN FOR REFERENCE ONLY AND ARE OWNER FURNISHED AND INSTALLED.
- DIMENSIONS TO ROUGH FACE OF ROUGH FRAMING OR FACE OF FIXTURE UNLESS OTHERWISE NOTED.
- D PROVIDE SUSPENDED CEILING SEISMIC BRACING, REFER TO DETAIL
- ALL FINISH SUBSTITUTION REQUEST REQUIRE OWNER PRIOR APPROVAL.

INTERIOR FINISH TYPES

TYPE: POLISHED CONCRETE FINISH MFG: (REFER TO PROJECT MANUAL - SECTION 03 35 43) COLOR: NATURAL CONCRETE, CLEAR

TYPE: LIQUID DENSIFIER TREATED CONCRETE FINISH MFG: (REFER TO PROJECT MANUAL - SECTION 03 30 00) COLOR: NATURAL CONCRETE, CLEAR

TYPE: RESILIENT BASE MFG: EQUAL TO VPI SIZE: 4" COVE COLOR: JET, #01

WALLS

TYPE: PAINT MFG: SHERWIN WILLIAMS SERIES: FLAT LATEX COLOR: SW6126 "NAVAJO WHITE"

TYPE: PAINT MFG: SHERWIN WILLIAMS SERIES: SEMI GLOSS LATEX

TYPE: PAINT MFG: SHERWIN WILLIAMS

SERIES: SEMI GLOSS LATEX

COLOR: SW6126 "NAVAJO WHITE"

COLOR: SW6468 "HUNT CLUB"

TYPE: SANITARY WALL AND CEILING PANEL SYSTEM MFG: (REFER PROJECT MANUAL) COLOR: WHITE

W-5: (ONLY WHERE INDICATED)

TYPE: PRE-ENGINEERED METAL BUILDING INTERIOR LINER PANEL MFG: (REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS) SERIES: EQUAL TO BUTLER BUILDING "MOD 36" (28 GA.) COLOR: PREFINISHED EQUAL TO BUTLER BUILDING "WHITE" OR "LIGHT

CEILINGS C-1:

TYPE: ACOUSTICAL TILE CEILING SIZE: 24" X 48" X 5/8", SQUARE EDGE MFG: ARMSTRONG SPECIFIED SERIES: 1729 "FINE FISSURED" COLOR: WHITE GRID SERIES: "PRELUDE" 15/16" EXPOSED TEE SYSTEM

GRID COLOR: WHITE

TYPE: PAINT MFG: SHERWIN WILLIAMS SERIES: FLAT LATEX COLOR: SW6126 "NAVAJO WHITE"

TYPE: PAINT MFG: SHERWIN WILLIAMS SERIES: SEMI GLOSS LATEX

COLOR: SW6126 "NAVAJO WHITE" TYPE: EXPOSED INSULATION VAPOR BARRIER (WHITE) AND EXPOSED STEEL FRAMING SYSTEM (FACTORY PRIMED)

DOORS AND FRAMES D-1 (INTERIOR WOOD DOORS):

SPECIES: CUSTOM GRADE ROTARY SLICED NATURAL BIRCH FINISH: FACTORY FINISHED COLOR: EQUAL TO "GRAHAM" #300, MEDIUM BROWN

D-2 (INTERIOR HOLLOW METAL FRAMES)

TYPE: PAINT MFG: SHERWIN WILLIAMS SERIES: SEMI GLOSS ENAMEL COLOR: SW6468 "HUNT CLUB"

D-3 (EXTERIOR DOORS & FRAMES):

TYPE: PAINT FINISH: REFER TO EXTERIOR FINISH SCHEDULE COLOR: REFER TO EXTERIOR FINISH SCHEDULE


SYMBOLS LEGEND



F-1: POLISHED CONCRETE:

F-2: LIQUID DENSIFIER TREATED CONCRETE

B-1: BASE:



ARCHITECT OF RECORD

ADAM KREHER ARCHITECT LICENSE NUMBER AR98768

SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

KR **JUNE 15, 2018**


PROJECT NUMBER:

18078-OF4

NO


FRONT EXTERIOR ELEVATION

SCALE: 1/8" = 1'-0"

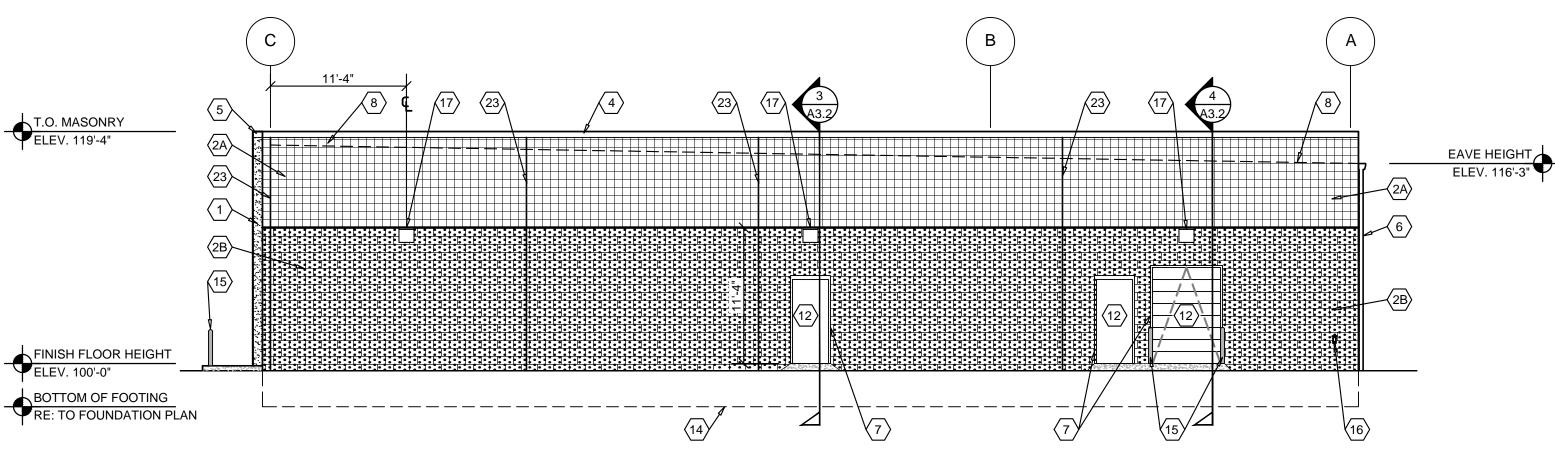


RIGHT EXTERIOR ELEVATION

A2.1 | SCALE: 1/8" = 1'-0"

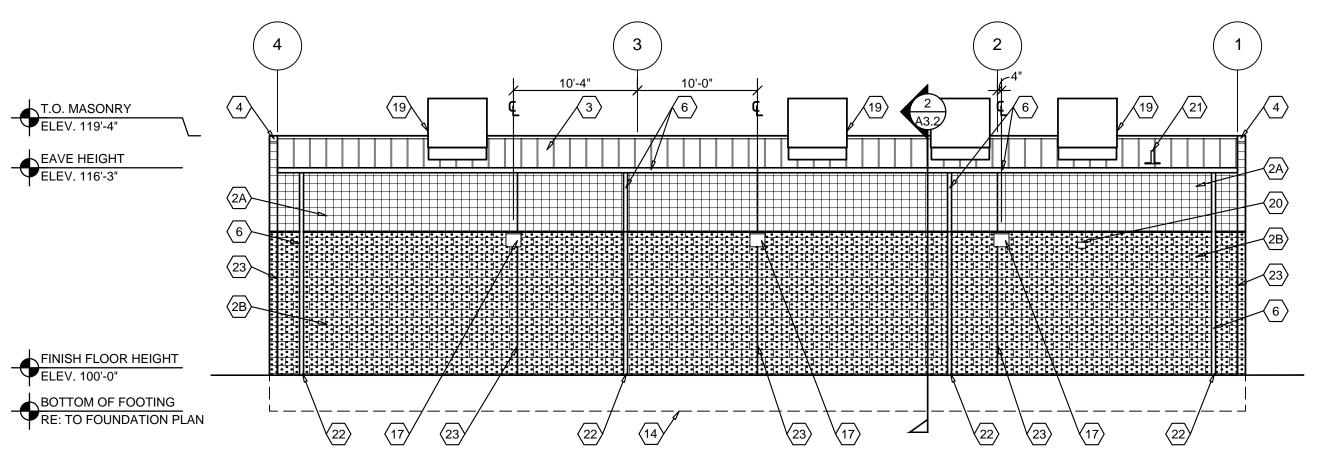

REAR EXTERIOR ELEVATION

A2.1 SCALE: 1/8" = 1'-0"

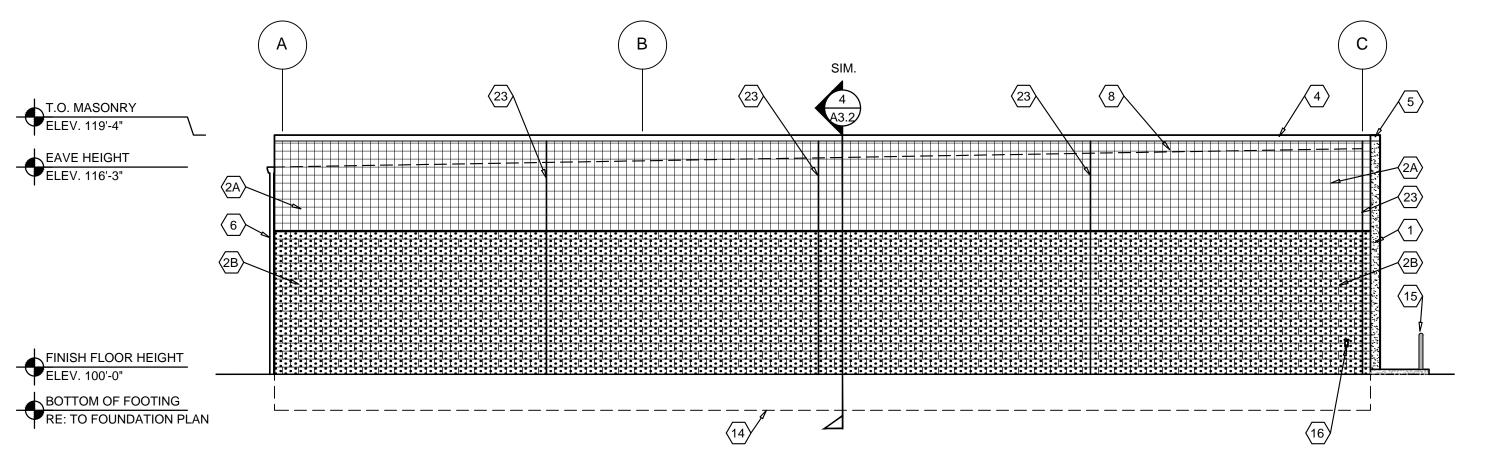

LEFT EXTERIOR ELEVATION

A2.1 | SCALE: 1/8" = 1'-0"

EXTERIOR FINISH SCHEDULE

EXTERIOR INSULATION AND FINISH SYSTEM (EIFS)

KEY NOTE NO. 1:

MFG: DRYVIT SPECIFIED. EQUAL BY STO OR BASF (NO SUBSTITUTES) SERIES: OUTSULATION PLUS MD TEXTURE: SANDBLAST

COLOR: DRYVIT "ORAP011030S" STRATOTONE HIGH PERFORMANCE COLOR STANDARD: SHERWIN WILLIAMS "POSITIVE RED" SW6871 (SHER-CRYL) GLOSS

UNIT MASONRY KEY NOTE NO. 2A:

TYPE: CONCRETE MASONRY UNIT (CMU) MFG: (REFER TO PROJECT MANUAL) SIZE: 8"X8"X16" (NOM.) TEXTURE: SMOOTH FACE SINGLE SCORE

COURSING: RUNNING BOND FINISH: FIELD PAINT (ACCENT COLOR)

COLOR: SHERWIN WILLIAMS "SOFTER TAN" SW6141 (SEMI-GLOSS) (1) COAT SW "PREPRITE" BLOCK FILLER B25W25 (NO LESS THAN 8 MILS) AND (2) COATS SW "CONFLEX XL" SMOOTH ELASTOMERIC A5-400 (NO LESS

COATS (COLD WEATHER APPLICATIONS):

(1) COAT SW "LOXON BLOCK SURFACER" (NO LESS THAN 8 MILS) AND (2) COATS SW "ULTRACRETE" SOLVENT BORNE SMOOTH B46 (NO LESS THAN 8

MILS EACH COAT OR 16 MILS TOTAL)

THAN 5.7 MILS EACH COAT)

KEY NOTE NO. 2B:

TYPE: CONCRETE MASONRY UNIT (CMU) MFG: (REFER TO PROJECT MANUAL) SIZE: 8"X8"X16" (NOM.) TEXTURE: SPLIT FACE

COURSING: RUNNING BOND FINISH: FIELD PAINT (FIELD COLOR)

COLOR: SHERWIN WILLIAMS "LATTE" SW6108 (SEMI-GLOSS)

(1) COAT SW "PREPRITE" BLOCK FILLER B25W25 (NO LESS THAN 8 MILS) AND (2) COATS SW "CONFLEX XL" SMOOTH ELASTOMERIC A5-400 (NO LESS THAN 5.7 MILS EACH COAT)

COATS (COLD WEATHER APPLICATIONS):

(1) COAT SW "LOXON BLOCK SURFACER" (NO LESS THAN 8 MILS) AND (2) COATS SW "ULTRACRETE" SOLVENT BORNE SMOOTH B46 (NO LESS THAN 8 MILS EACH COAT OR 16 MILS TOTAL)

FLASHING AND SHEET METAL **KEY NOTE NO. 3:**

TYPE: STANDING SEAM ROOFING SYSTEM MFG: (REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS) COLOR: WHITE REFLECTIVITY: 80% EMITTANCE: 90%

COLOR: EQUAL TO BUTLER BUILDING "COOL BIRCH WHITE"

KEY NOTE NO. 4:

INDEX: 100

TYPE: CAP FLASHING AT MASONRY

MFG: (REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS) FINISH: PREFINISHED

KEY NOTE NO. 5:

TYPE: CAP FLASHING AT EXTERIOR INSULATION FINISH SYSTEM (EIFS) MFG: (REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS) FINISH: FACTORY PRIMED AND FIELD PAINT

COLOR: SHERWIN WILLIAMS "POSITIVE RED" SW6871 (SHER-CRYL) GLOSS WITH SHERWIN WILLIAMS THREE COMPONENT (B65T105 / B65V105 / B65C105) CLEAR URETHANE

KEY NOTE NO. 6:

TYPE: GUTTER AND DOWNSPOUTS

MFG: (REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS)

FINISH: PREFINISHED COLOR: EQUAL TO BUTLER BUILDING "COOL BIRCH WHITE"

DOORS AND WINDOWS KEY NOTE NO. 12:

TYPE: STEEL DOORS AND FRAMES (DOORS NO. 2, 3, AND 7)

MFG: (OWNER FURNISHED / CONTRACTOR INSTALLED) FINISH: FACTORY PRIMED AND FIELD PAINTED

COLOR: SHERWIN WILLIAMS "LATTE" SW6108 (SEMI-GLOSS)

TYPE: (REFER TO WINDOW SCHEDULE)

MFG: EFCO, KAWNEER, OR OLD CASTLE (VISTA WALL). (NO SUBSTITUTES) COLOR: EFCO "IVY", KAWNEER "DARK IVY", VISTA WALL "INTERSTATE

KEY NOTE NO. 15:

TYPE: STEEL BOLLARDS (REFER TO CIVIL DRAWINGS) FINISH: FIELD PRIME AND PAINT

COLOR: SHERWIN WILLIAMS "HUNT CLUB" SW6468 (SEMI-GLOSS)

GENERAL NOTES

(A) REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.

B REFER TO CIVIL DRAWINGS FOR ADDITIONAL REQUIREMENTS.

C REFER TO PLUMBING, MECHANICAL, AND ELECTRICAL DRAWINGS FOR SYSTEM TYPES AND ADDITIONAL REQUIREMENTS.

D REFER TO EXTERIOR FINISH SCHEDULE FOR MATERIAL TYPES.

(E) REFER TO PRE-ENGINEERED METAL BUILDING SHOP DRAWINGS FOR ADDITIONAL REQUIREMENTS.

F REFER TO SCOPE OF WORK SCHEDULE FOR ADDITIONAL REQUIREMENTS.

KEY NOTES

1 EXTERIOR INSULATION AND FINISH SYSTEM (EIFS).

(2A) CONCRETE MASONRY UNIT (CMU) EXTERIOR WALL CONSTRUCTION (ACCENT COLOR). REFER TO PLANS, SECTIONS, AND DETAILS FOR ADDITIONAL REQUIREMENTS.

CONCRETE MASONRY UNIT (CMU) EXTERIOR WALL CONSTRUCTION (FIELD COLOR). REFER TO PLANS, SECTIONS, AND DETAILS FOR ADDITIONAL REQUIREMENTS.

3 PRE-ENGINEERED METAL BUILDING SHEET METAL ROOFING

PRE-ENGINEERED METAL BUILDING SHEET METAL FLASHING (AT

PRE-ENGINEERED METAL BUILDING SHEET METAL FLASHING (AT EIFS)

6 PRE-ENGINEERED METAL BUILDING SHEET METAL GUTTER AND

DOWNSPOUT SYSTEM. (7) CONCRETE MASONRY UNIT (CMU) CORNER FINISHED JAMB UNIT.

 $\langle 8 \rangle$ LINE OF ROOF BEYOND WITH 1/4":12" SLOPE MINIMUM.

9 SURFACE MOUNTED SIGN OWNER FURNISHED AND INSTALLED. PROVIDE BACKING FOR MOUNTING AND ROUGH-IN ELECTRICAL. COORDINATE REQUIREMENTS WITH OWNER. REFER TO SHEET

BUILDING ADDRESS NUMBERS IN 6" HIGH HELVETICA WHITE VINYL ADHERED TO EXTERIOR FACE OF GLAZING.

(NOT USED).

EXTERIOR DOOR AND FRAME SYSTEM. REFER TO FLOOR PLAN AND DOOR SCHEDULE FOR TYPES.

EXTERIOR WINDOW SYSTEM. REFER TO FLOOR PLAN AND WINDOW SCHEDULE FOR TYPES.

414 APPROXIMATE LINE OF FOUNDATION, REFER TO STRUCTURAL

5 STEEL BOLLARDS, REFER TO CIVIL AND STRUCTURAL DRAWINGS.

(16) HOSE BIB, REFER TO PLUMBING DRAWINGS.

17 LIGHT FIXTURE, REFER TO ELECTRICAL DRAWINGS.

(NOT USED)

MECHANICAL ROOF TOP UNIT, REFER TO MECHANICAL DRAWINGS.

MECHANICAL WALL PENETRATIONS, REFER TO MECHANICAL DRAWINGS. PROVIDE FRAMING, FLASHING, AND SEALANT AS

21) PLUMBING ROOF VENT, REFER TO PLUMBING DRAWINGS AND DETAIL 11/A4.2.

DOWNSPOUTS TO TIE INTO STORM WATER PER CIVIL.

MASONRY CONTROL JOINT, REFER TO STRUCTURAL DRAWINGS. PROVIDE SEALANT OVER 1/2" DIAMETER FOAM BACKER ROD.

RUSTICATION JOINT, REFER TO DETAIL 6/A3.2.

ADAM KREHER


SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS R INSTRUMENTS ARE DISCLAIMED.

ge

NO KR **JUNE 15, 2018**

PROJECT NUMBER:

18078-OF4

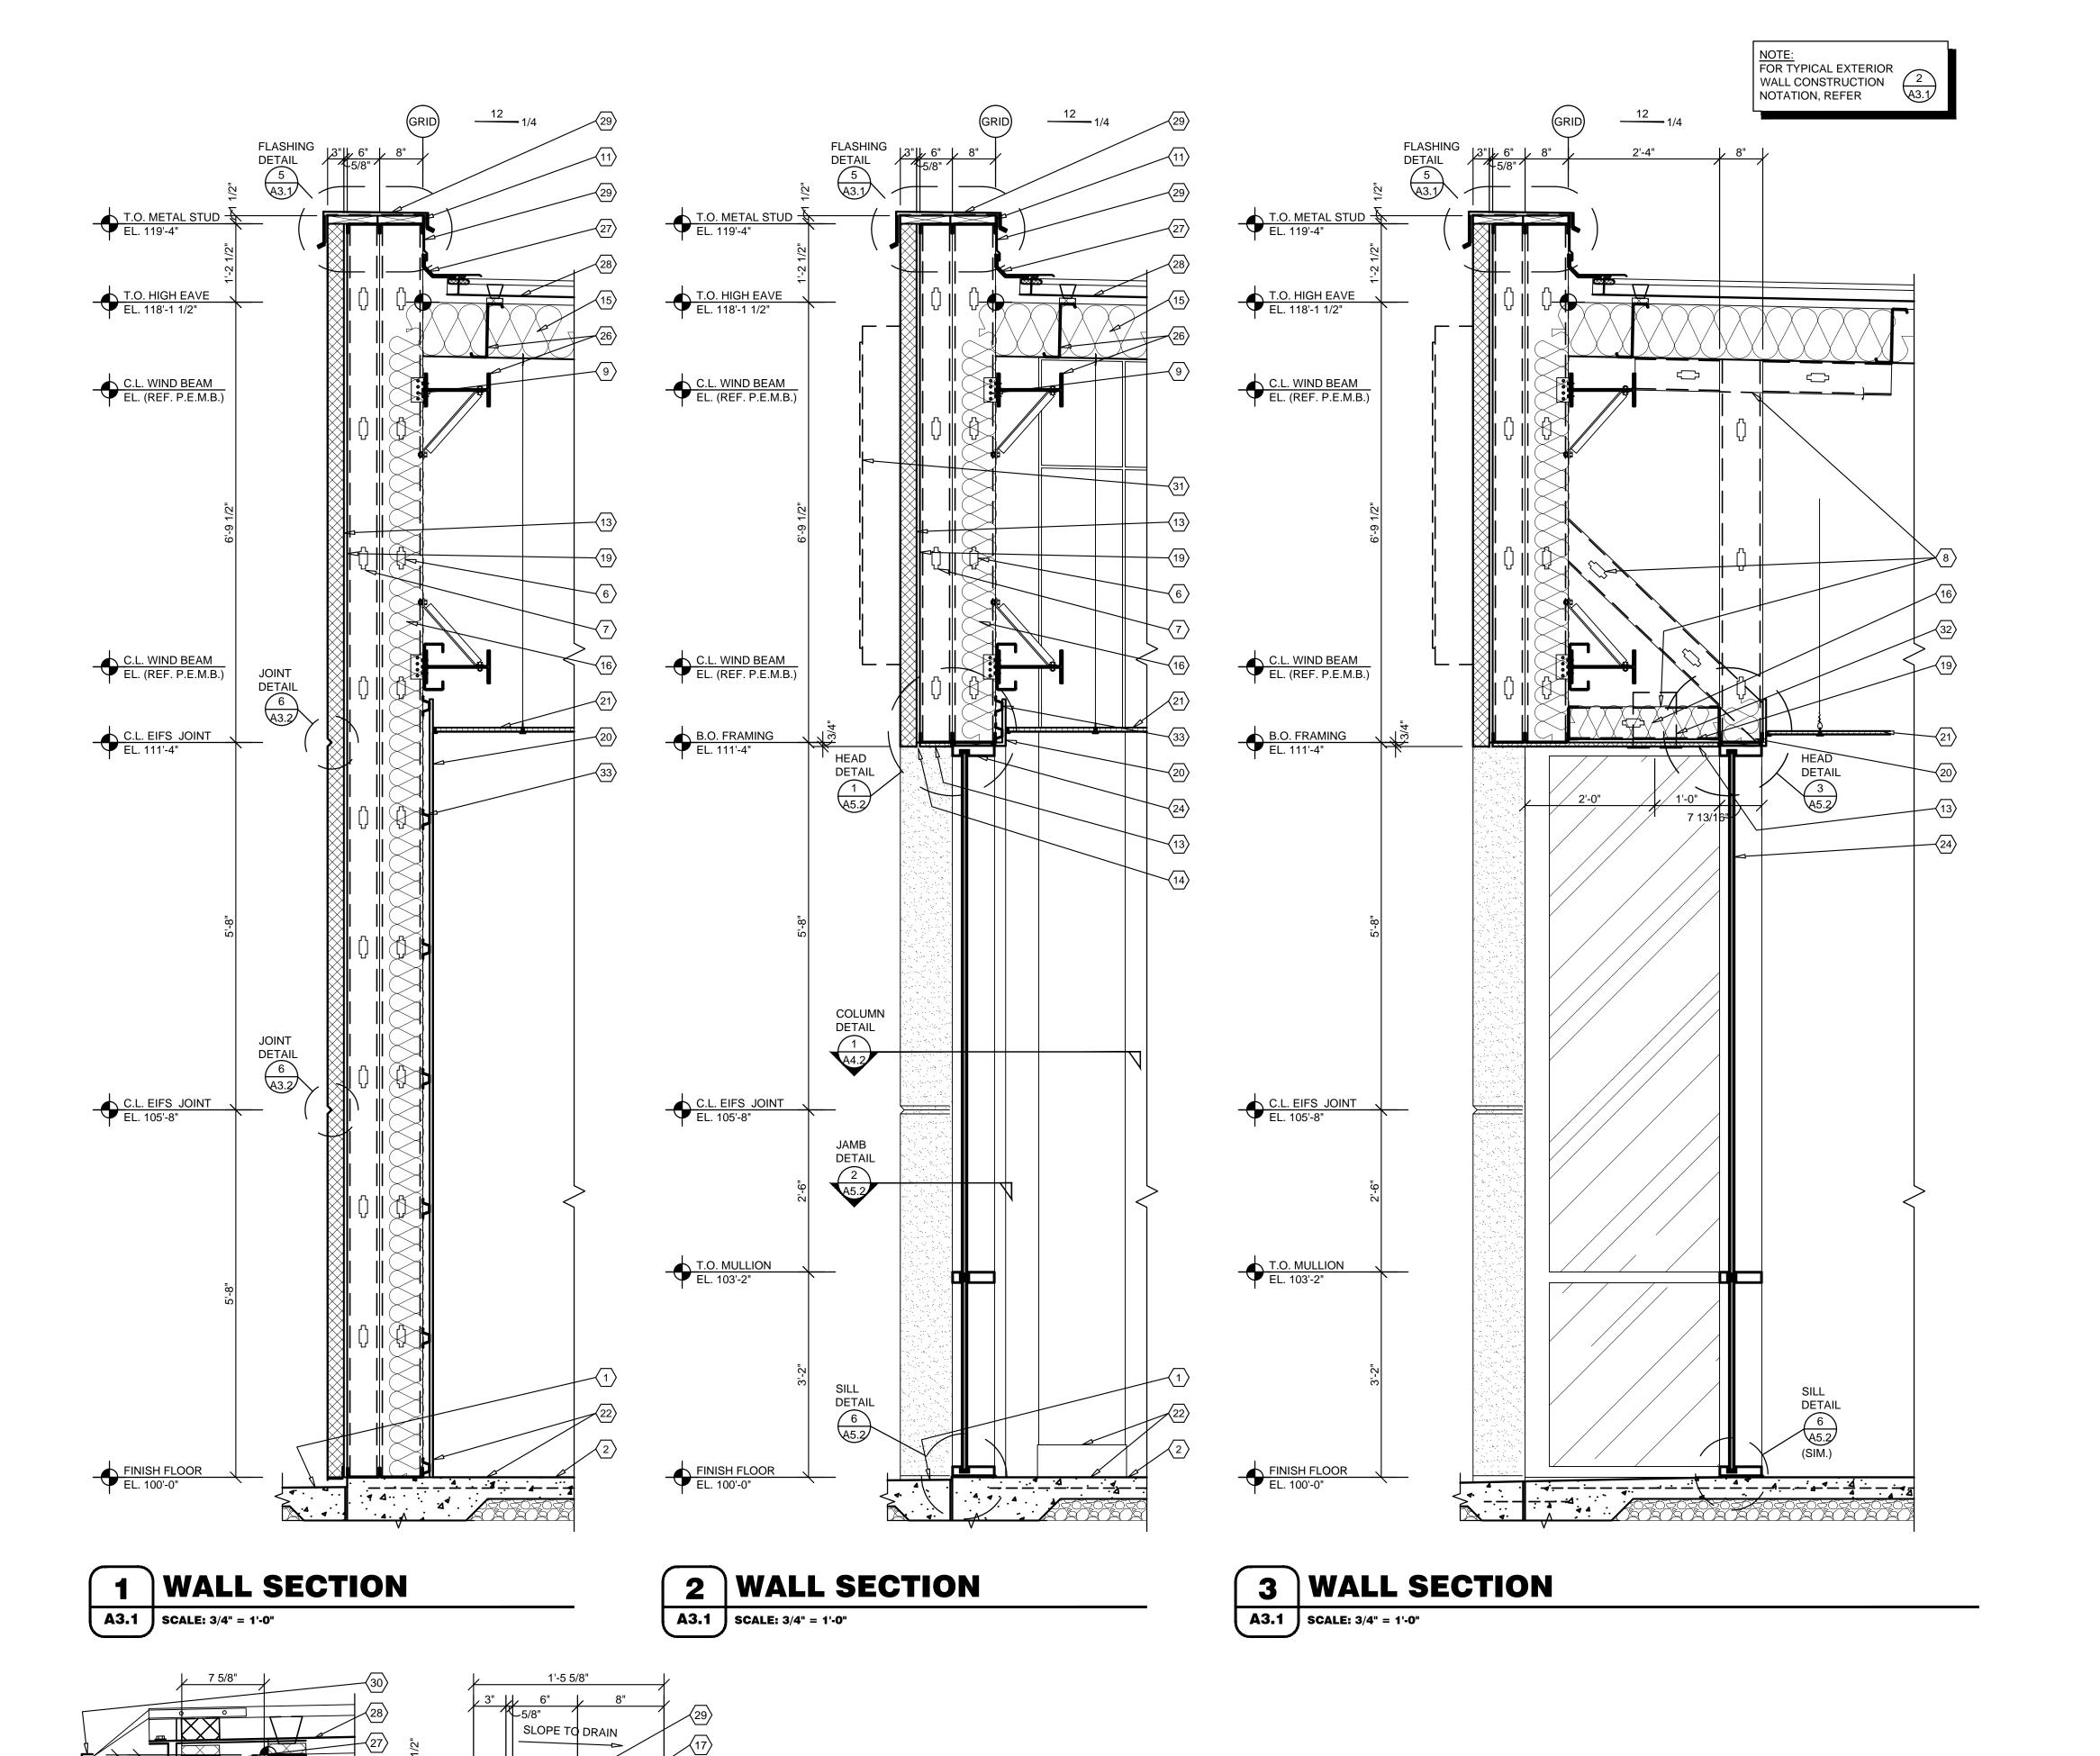

(NOT USED)

A3.1 | SCALE: NTS

SECTION

SCALE: 1 1/2" = 1'-0"

SECTION

SCALE: 1 1/2" = 1'-0"


(NOT USED) SCALE: NTS

GENERAL NOTES

- (A) REFER TO PROJECT MANUAL AND SCOPE OF WORK SCHEDULE FOR ADDITIONAL REQUIREMENTS.
- B REFER TO CIVIL, STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND PRE-ENGINEERED METAL BUILDING (P.E.M.B.) SHOP DRAWINGS FOR ADDITIONAL REQUIREMENTS.
- © REFER TO INTERIOR AND EXTERIOR FINISH SCHEDULES FOR MATERIAL TYPES, COLORS AND FINISHES.
- ⟨D⟩ DIMENSIONS ARE TO FACE OF CONCRETE, MASONRY, FRAMING, OR CENTER LINE OF STRUCTURE UNLESS OTHERWISE INDICATED.
- E REFER TO EXTERIOR ELEVATIONS FOR MASONRY CONTROL JOINT

KEY NOTES

- finish Lawn, pavement or sidewalk, slope to drain away from building. Refer to civil drawings.
- (2) CONCRETE FLOOR SLAB. REFER TO STRUCTURAL DRAWINGS.
- (NOT USED)
- 4 SMOOTH FACE SINGLE SCORE CONCRETE MASONRY UNIT (CMU), (7 5/8" X 7 5/8" X 15 5/8") IN RUNNING BOND WITH HORIZONTAL REINFORCEMENT AT 16" O.C.. REFER TO STRUCTURAL DRAWINGS FOR VERTICAL REINFORCEMENT REQUIREMENTS.
- CONCRETE MASONRY UNIT (CMU) BOND BEAM, REFER TO STRUCTURAL DRAWING FOR REINFORCEMENT REQUIREMENTS.
- 6 8" COLD FORM METAL FRAMING, REFER TO STRUCTURAL DRAWINGS.
- $\overline{7}$ 6" COLD FORM METAL FRAMING, REFER TO STRUCTURAL DRAWINGS.
- 8 6" (18 GA.) COLD FORM METAL STUD FRAMING AT 24" O.C. ATTACHED TO PRE ENGINEERED METAL BUILDING STRUCTURAL FRAMING SYSTEM.
- © COLD FORM METAL STUD FRAMING CLIP, REFER TO STRUCTURAL DRAWINGS.
- (10) (NOT USED)
- (11) FIRE TREATED 2X NAILER(S) CONTINUOUS. CUT TO FIT WALL WIDTH. ATTACHED TO METAL STUD FRAMING WITH #12 SCREWS AT 24" O.C. STAGGERED. ATTACHED TO CMU BOND BEAM WITH 1/2" DIA. ANCHORS AT 32" O.C..
- (12) (NOT USED)
- (13) EXTERIOR INSULATION FINISH SYSTEM (EIFS) OVER RIGID INSULATION DRAINAGE BOARD IN THICKNESS INDICATED.
- $\langle 14 \rangle$ EXTERIOR INSULATION FINISH SYSTEM (EIFS) DRIP.
- (15) PRE-ENGINEERED METAL BUILDING ROOF INSULATION (R-36) LINER SYSTEM, (REFER TO SCOPE OF WORK SCHEDULE). VAPOR BARRIER OVER HIGH STRENGTH STEEL SUSPENSION STRAPS ATTACHED TO BOTTOM OF PRE-ENGINEERED METAL BUILDING ROOF PURLINS WITH (1) LAYER 8" (R-25) UN-FACED BATT INSULATION PARALLEL WITH ROOF PURLIN CAVITY AND (1) LAYER 3 1/2" (R-11) UN-FACED BATT INSULATION PERPENDICULAR OVER TOP OF ROOF PURLINS.
- (16) 6" (R-19) BATT INSULATION WITH FOIL FACE VAPOR BARRIER.
- FLEXIBLE FLASHING CONTINUOUS TO LAP OVER NAILERS AND DOWN BEHIND CONTINUOUS CLEATS ON BOTH SIDES. LAP JOINTS 8" MINIMUM AND MASTIC.
- (NOT USED)
- (19) 5/8" EXTERIOR FIBERGLASS REINFORCED SHEATHING WITH CONTINUOUS WEATHER BARRIER. REFER TO STRUCTURAL DRAWINGS FOR ATTACHMENT REQUIREMENTS.
- $\langle 20 \rangle$ 5/8" TYPE "X" GYPSUM BOARD. REFER TO INTERIOR WALL TYPES FOR ADDITIONAL REQUIREMENTS.
- SUSPENDED ACOUSTICAL LAY IN CEILING SYSTEM. REFER TO INTERIOR FINISH SCHEDULE FOR TYPES AND LOCATIONS.
- 22 FLOORING AND BASE, REFER TO INTERIOR FINISH SCHEDULE FOR
- TYPES AND LOCATIONS. (NOT USED)
- ALUMINUM WINDOW SYSTEM. REFER TO FLOOR PLAN AND WINDOW SCHEDULES FOR TYPES.
- (NOT USED)
- PRE-ENGINEERED METAL BUILDING PRIMARY AND SECONDARY $\langle 26 \rangle$ STRUCTURAL FRAMING SYSTEMS.
- PRE-ENGINEERED METAL BUILDING TRANSITION SUPPORT PLATE
- 28 PRE-ENGINEERED METAL BUILDING ROOF PANEL SYSTEM WITH THERMAL SPACER BLOCKS (R-5 MIN.).
- PRE-ENGINEERED METAL BUILDING SHEET METAL FLASHING, COUNTER FLASHING, CONTINUOUS CLEATS, DRIPS CLOSURES, TRANSITIONS, COPINGS AND ACCESSORIES AS REQUIRED.
- PRE-ENGINEERED METAL BUILDING GUTTER AND DOWNSPOUT SYSTEM. REFER TO EXTERIOR ELEVATIONS FOR LOCATIONS. REFER TO P.E.M.B. SHOP DRAWINGS FOR SIZES.
- 31 SURFACE MOUNTED WALL SIGN, OWNER FURNISHED AND INSTALLED, (REFER TO SCOPE OF WORK SCHEDULE), PROVIDE BACKING AND ELECTRICAL ROUGH-IN, REFER TO ELECTRICAL DRAWINGS.
- RECESSED LIGHTING FIXTURE, REFER TO ELECTRICAL DRAWINGS FOR TYPE AND LOCATION.
- (33) 1 1/4" (20 GAGE) DOUBLE LEG COLD FORM METAL RESILIENT CHANNEL FRAMING AT 24" O.C. HORIZONTAL.



ARCHITECT OF RECORD

ADAM KREHER ARCHITECT LICENSE NUMBER AR98768 SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS

R INSTRUMENTS ARE DISCLAIMED.




EZ OO

4010

KR

NO

JUNE 15, 2018

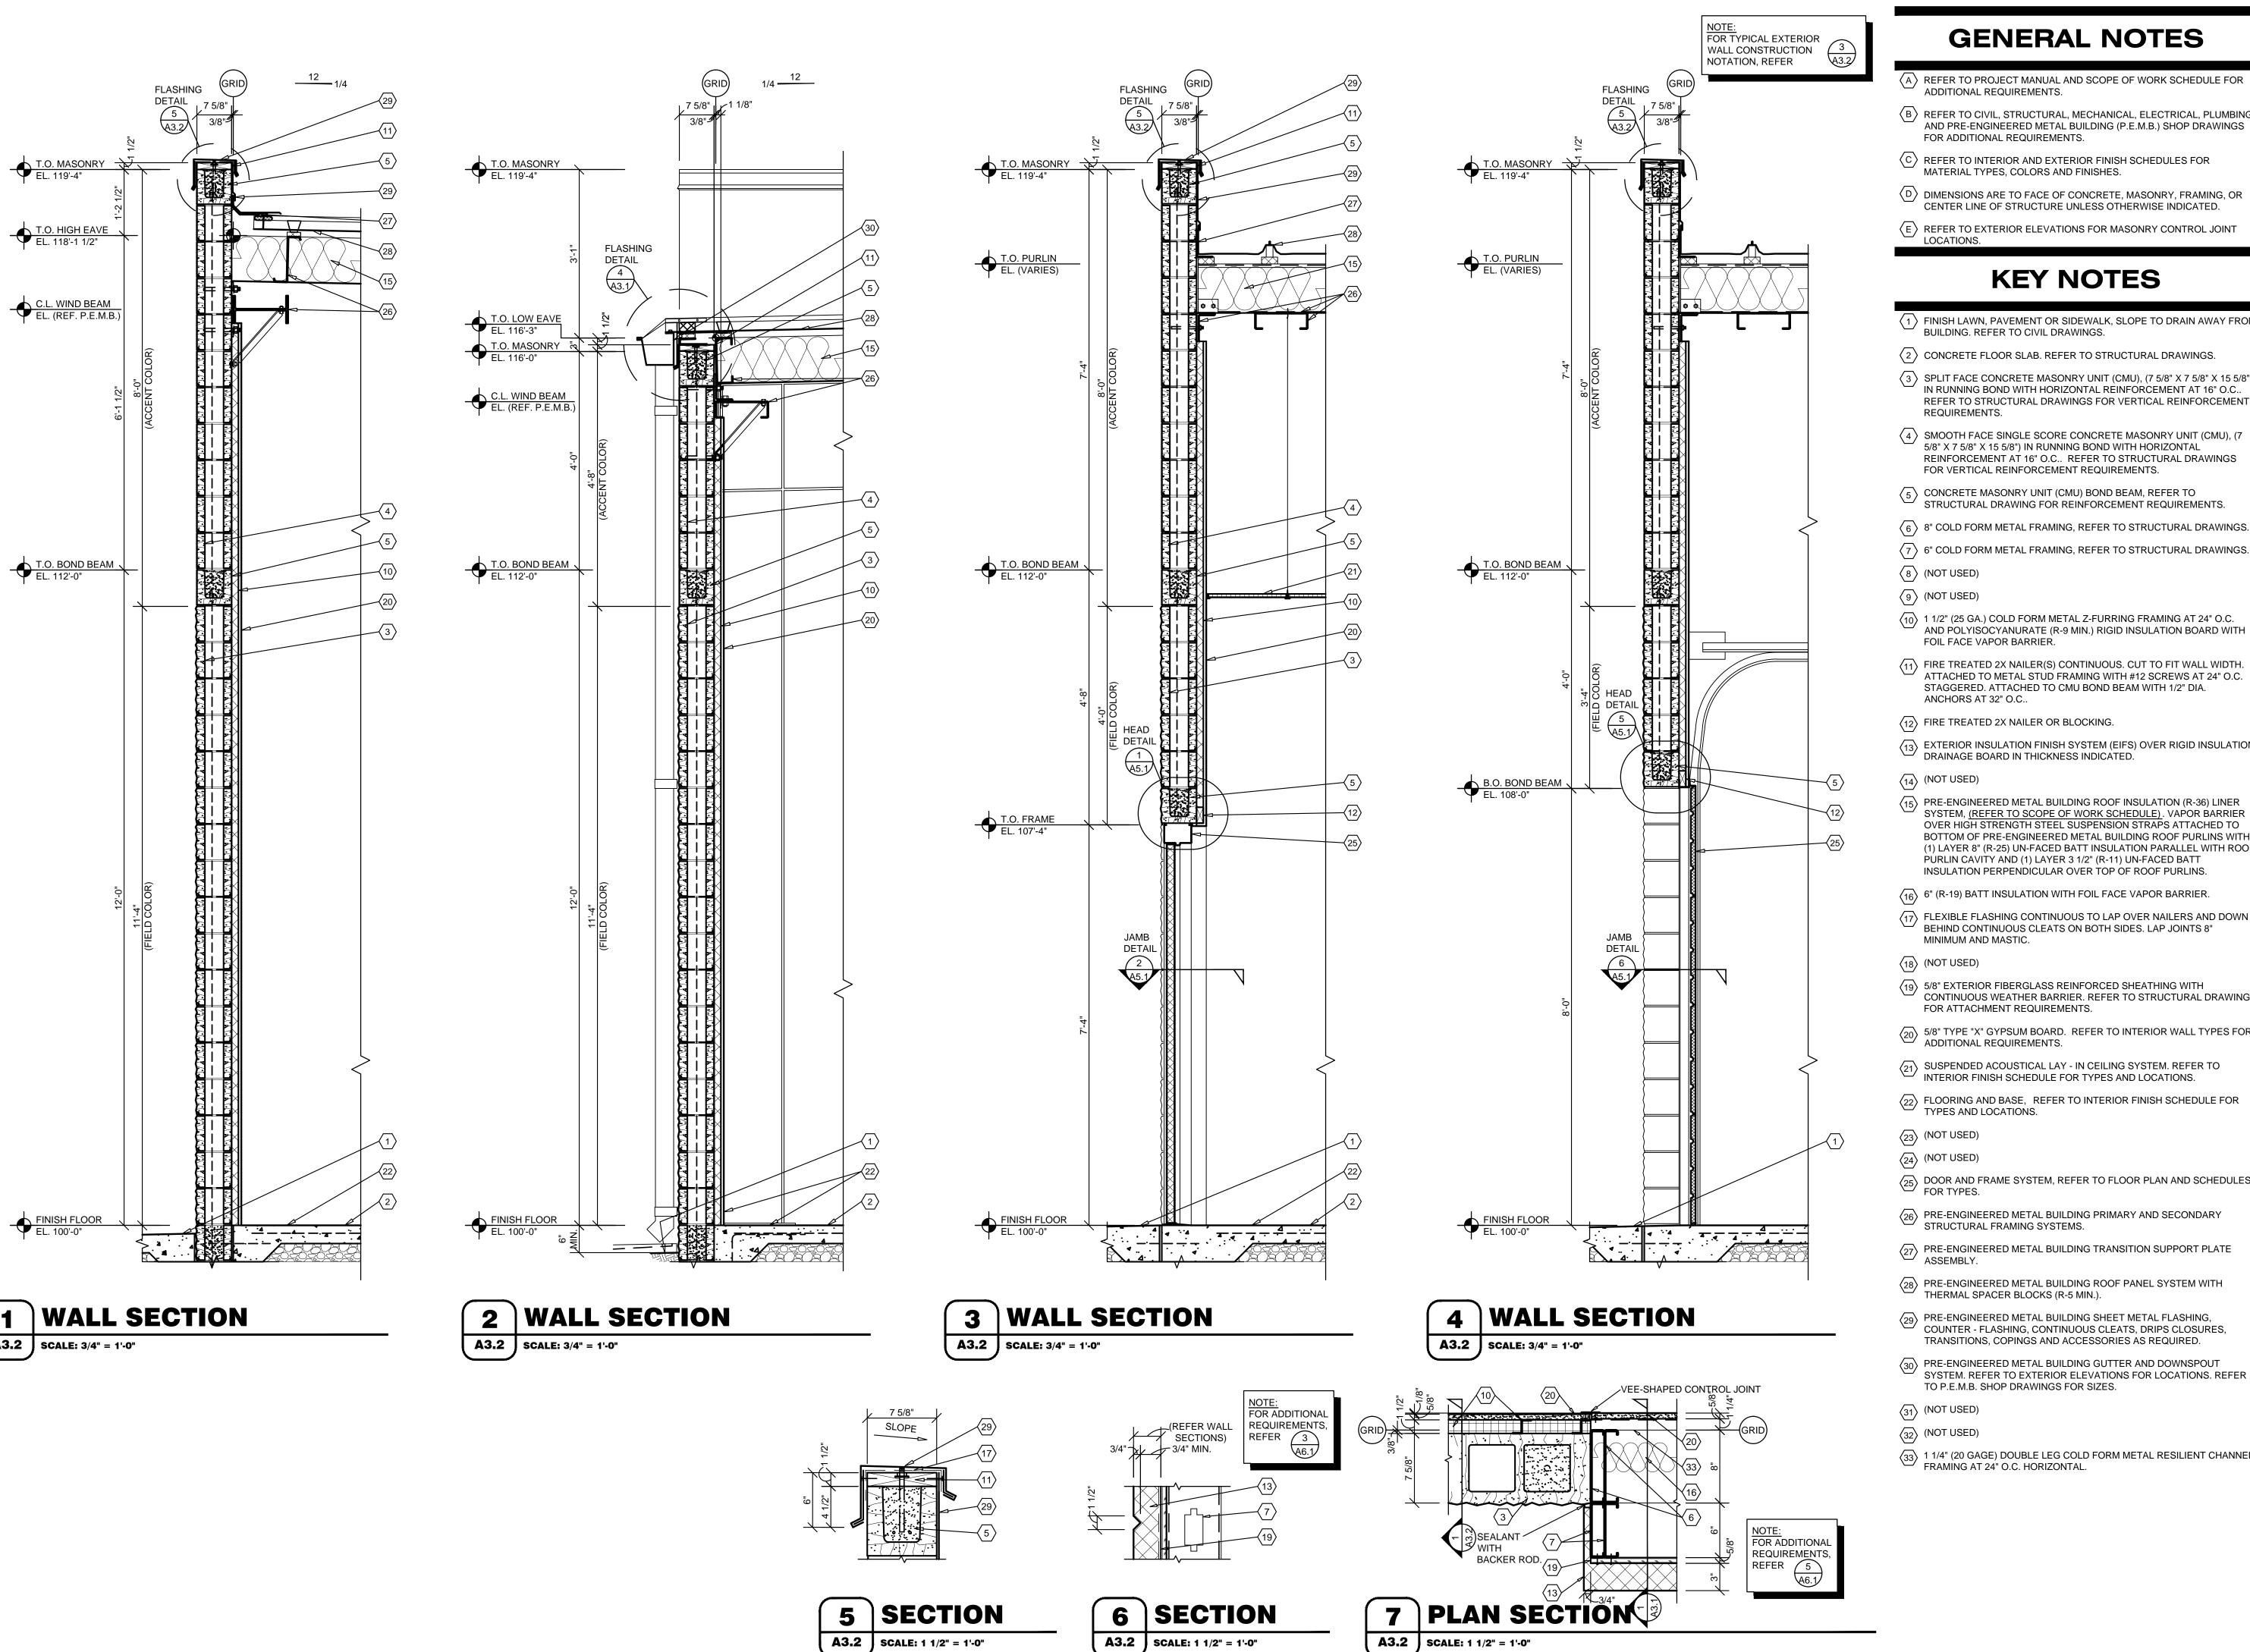

- (A) REFER TO PROJECT MANUAL AND SCOPE OF WORK SCHEDULE FOR ADDITIONAL REQUIREMENTS.
- B REFER TO CIVIL, STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING, AND PRE-ENGINEERED METAL BUILDING (P.E.M.B.) SHOP DRAWINGS FOR ADDITIONAL REQUIREMENTS.
 - © REFER TO INTERIOR AND EXTERIOR FINISH SCHEDULES FOR
 - MATERIAL TYPES, COLORS AND FINISHES. ⟨D⟩ DIMENSIONS ARE TO FACE OF CONCRETE, MASONRY, FRAMING, OR
- CENTER LINE OF STRUCTURE UNLESS OTHERWISE INDICATED.
- (E) REFER TO EXTERIOR ELEVATIONS FOR MASONRY CONTROL JOINT

KEY NOTES

- FINISH LAWN, PAVEMENT OR SIDEWALK, SLOPE TO DRAIN AWAY FROM BUILDING. REFER TO CIVIL DRAWINGS.
- (2) CONCRETE FLOOR SLAB. REFER TO STRUCTURAL DRAWINGS.
- (3) SPLIT FACE CONCRETE MASONRY UNIT (CMU), (7 5/8" X 7 5/8" X 15 5/8") IN RUNNING BOND WITH HORIZONTAL REINFORCEMENT AT 16" O.C..
- 4 SMOOTH FACE SINGLE SCORE CONCRETE MASONRY UNIT (CMU), (7 5/8" X 7 5/8" X 15 5/8") IN RUNNING BOND WITH HORIZONTAL REINFORCEMENT AT 16" O.C.. REFER TO STRUCTURAL DRAWINGS FOR VERTICAL REINFORCEMENT REQUIREMENTS.
- CONCRETE MASONRY UNIT (CMU) BOND BEAM, REFER TO STRUCTURAL DRAWING FOR REINFORCEMENT REQUIREMENTS.
- 6 8" COLD FORM METAL FRAMING, REFER TO STRUCTURAL DRAWINGS.
- $\langle 7 \rangle$ 6" COLD FORM METAL FRAMING, REFER TO STRUCTURAL DRAWINGS.
- (8) (NOT USED)
- 9 (NOT USED)
- $\langle 10 \rangle$ 1 1/2" (25 GA.) COLD FORM METAL Z-FURRING FRAMING AT 24" O.C. AND POLYISOCYANURATE (R-9 MIN.) RIGID INSULATION BOARD WITH FOIL FACE VAPOR BARRIER.
- (11) FIRE TREATED 2X NAILER(S) CONTINUOUS. CUT TO FIT WALL WIDTH. ATTACHED TO METAL STUD FRAMING WITH #12 SCREWS AT 24" O.C. STAGGERED. ATTACHED TO CMU BOND BEAM WITH 1/2" DIA. ANCHORS AT 32" O.C..
- $\langle 12 \rangle$ FIRE TREATED 2X NAILER OR BLOCKING.
- EXTERIOR INSULATION FINISH SYSTEM (EIFS) OVER RIGID INSULATION DRAINAGE BOARD IN THICKNESS INDICATED.
- (NOT USED)
- (15) PRE-ENGINEERED METAL BUILDING ROOF INSULATION (R-36) LINER SYSTEM, (REFER TO SCOPE OF WORK SCHEDULE). VAPOR BARRIER OVER HIGH STRENGTH STEEL SUSPENSION STRAPS ATTACHED TO BOTTOM OF PRE-ENGINEERED METAL BUILDING ROOF PURLINS WITH (1) LAYER 8" (R-25) UN-FACED BATT INSULATION PARALLEL WITH ROOF PURLIN CAVITY AND (1) LAYER 3 1/2" (R-11) UN-FACED BATT INSULATION PERPENDICULAR OVER TOP OF ROOF PURLINS.
- $\langle 16 \rangle$ 6" (R-19) BATT INSULATION WITH FOIL FACE VAPOR BARRIER.
- MINIMUM AND MASTIC.
- $\langle 18 \rangle$ (NOT USED)
- (19) 5/8" EXTERIOR FIBERGLASS REINFORCED SHEATHING WITH CONTINUOUS WEATHER BARRIER. REFER TO STRUCTURAL DRAWINGS FOR ATTACHMENT REQUIREMENTS.
- 5/8" TYPE "X" GYPSUM BOARD. REFER TO INTERIOR WALL TYPES FOR ADDITIONAL REQUIREMENTS.
- SUSPENDED ACOUSTICAL LAY IN CEILING SYSTEM. REFER TO INTERIOR FINISH SCHEDULE FOR TYPES AND LOCATIONS.
- FLOORING AND BASE, REFER TO INTERIOR FINISH SCHEDULE FOR TYPES AND LOCATIONS.
- (NOT USED)
- $\langle 24 \rangle$ (NOT USED)
- DOOR AND FRAME SYSTEM, REFER TO FLOOR PLAN AND SCHEDULES FOR TYPES.
- PRE-ENGINEERED METAL BUILDING PRIMARY AND SECONDARY STRUCTURAL FRAMING SYSTEMS.
- PRE-ENGINEERED METAL BUILDING TRANSITION SUPPORT PLATE ASSEMBLY.
- PRE-ENGINEERED METAL BUILDING ROOF PANEL SYSTEM WITH THERMAL SPACER BLOCKS (R-5 MIN.).
- PRE-ENGINEERED METAL BUILDING SHEET METAL FLASHING, COUNTER FLASHING, CONTINUOUS CLEATS, DRIPS CLOSURES, TRANSITIONS, COPINGS AND ACCESSORIES AS REQUIRED.
- PRE-ENGINEERED METAL BUILDING GUTTER AND DOWNSPOUT SYSTEM. REFER TO EXTERIOR ELEVATIONS FOR LOCATIONS. REFER TO P.E.M.B. SHOP DRAWINGS FOR SIZES.
- (NOT USED)
- (NOT USED)
- 1 1/4" (20 GAGE) DOUBLE LEG COLD FORM METAL RESILIENT CHANNEL FRAMING AT 24" O.C. HORIZONTAL.


ARCHITECT OF RECORD

ADAM KREHER ARCHITECT LICENSE NUMBER AR98768 SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS

KR

JUNE 15, 2018

NO

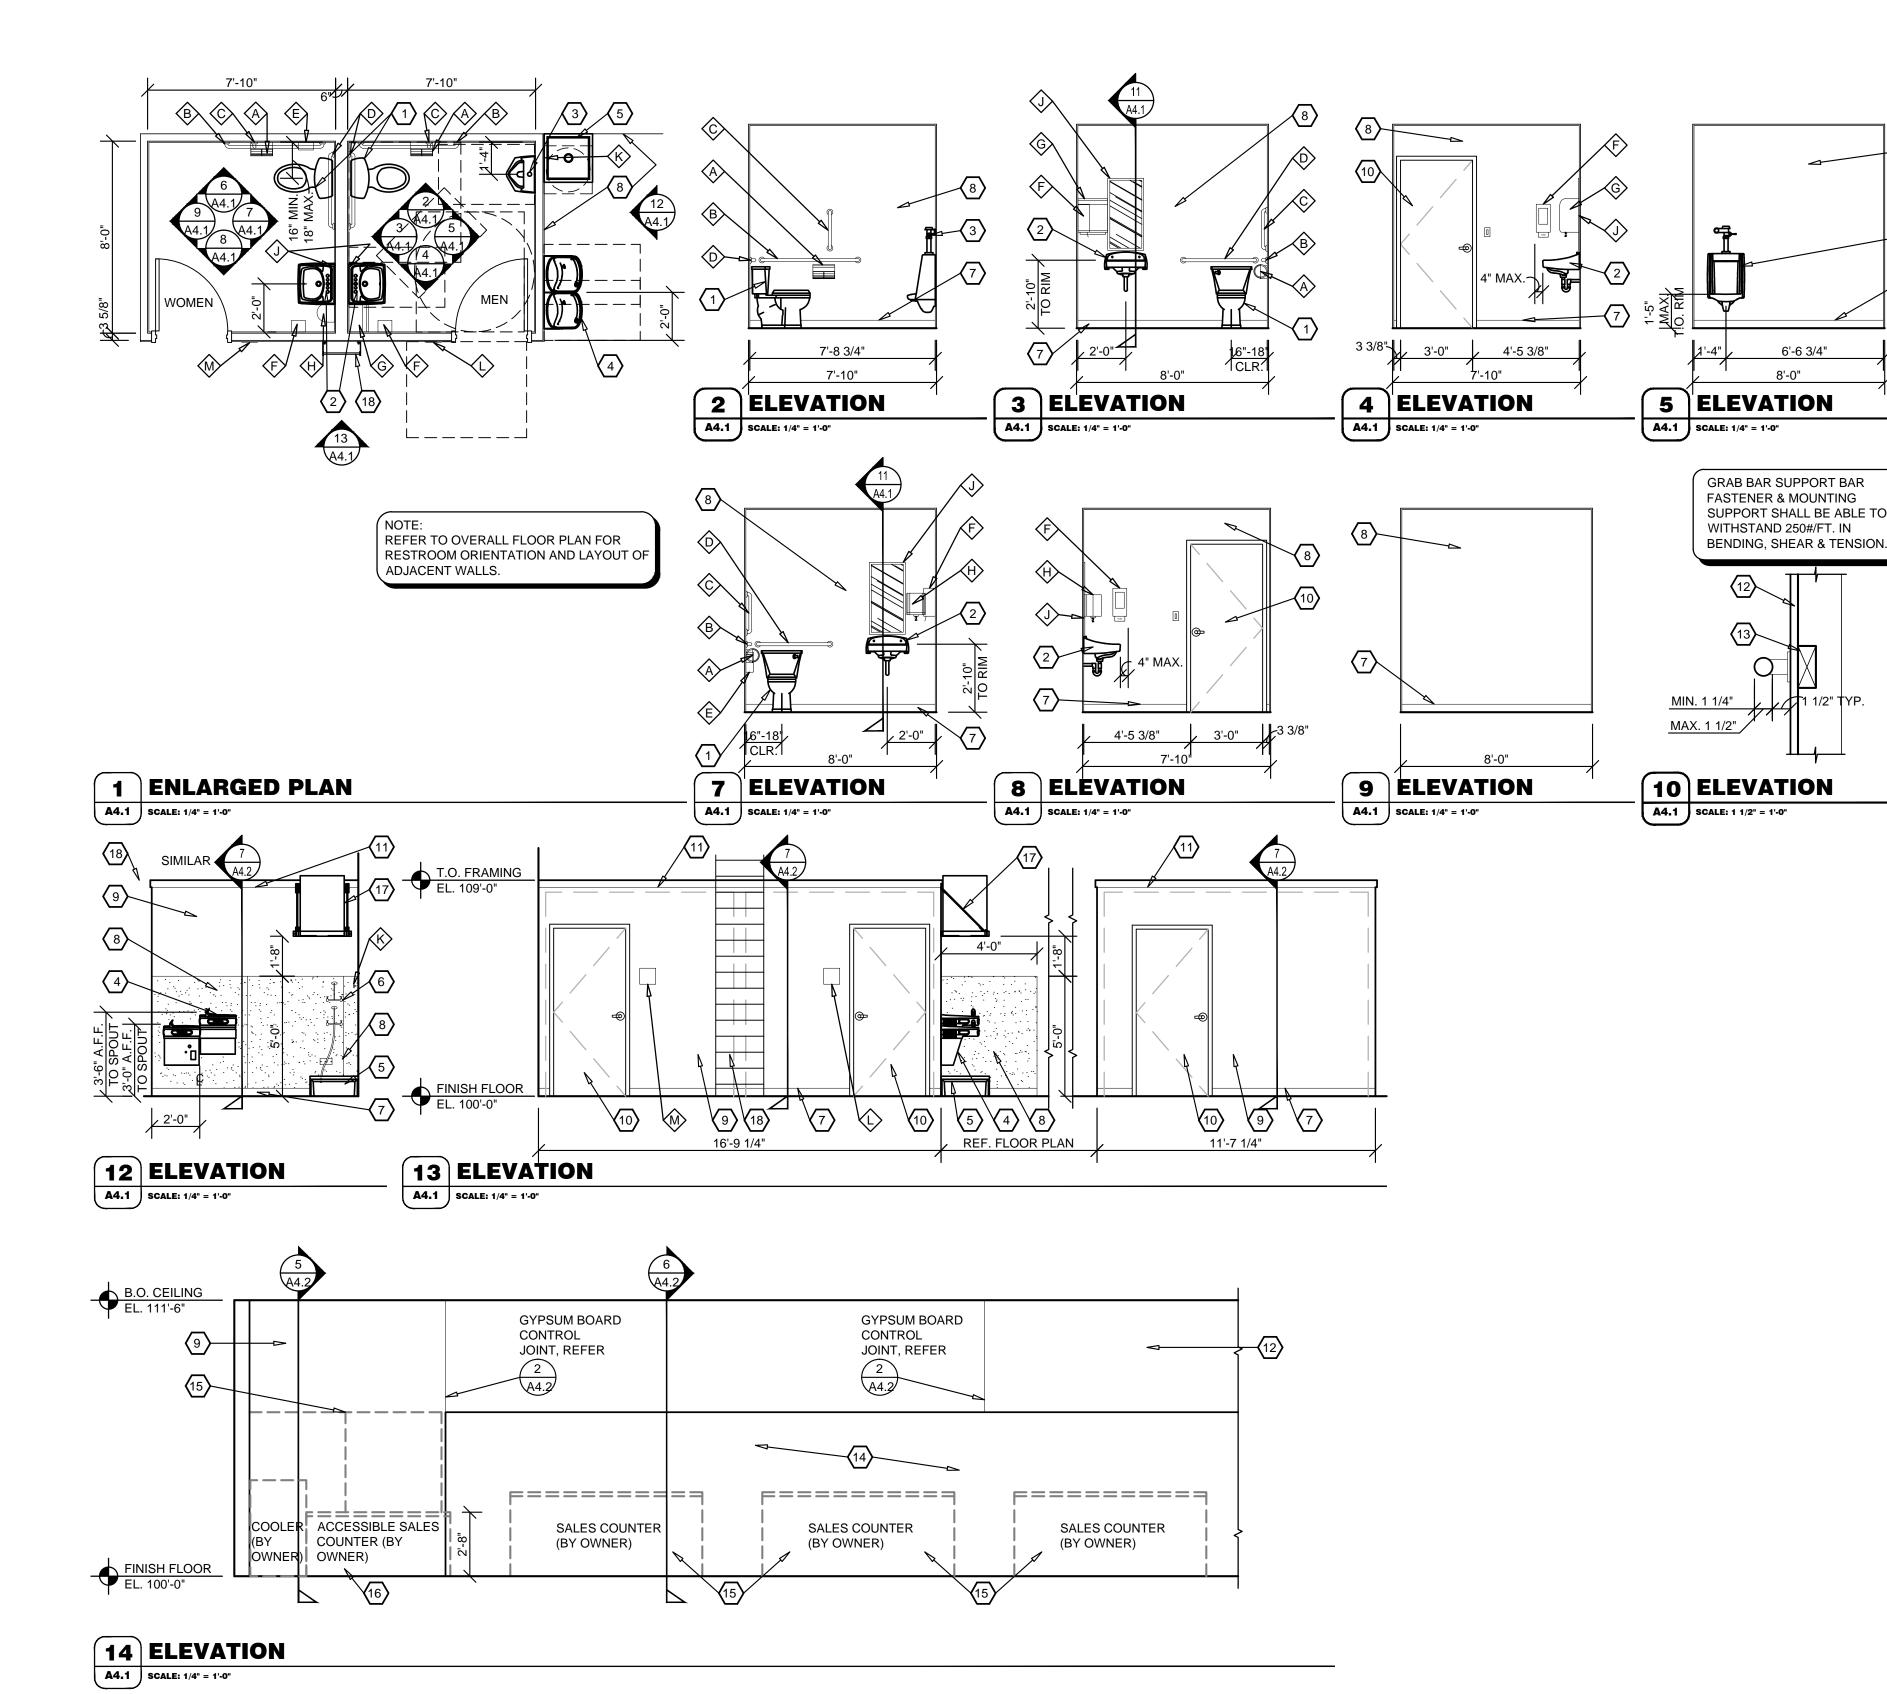

(A) REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.

7'-8 3/4"

7'-10"

6 ELEVATION

A4.1 SCALE: 1/4" = 1'-0"

ALL EXPOSED

COVERED W/

INSULATION.

A4.1 SCALE: 1/2" = 1'-0"

LAVATORY

11 CLEARANCES

PIPING TO BE

17" MIN.

- B LAYOUT DIMENSIONS OF PLUMBING FIXTURES AND ACCESSORIES TO FACE OF GYPSUM BOARD OR CENTER LINE OF FIXTURE. LAYOUT DIMENSIONS OF WALLS AND CEILINGS TO ROUGH FACE OF FRAMING, MASONRY, OR CENTER LINE OF STRUCTURE. ALL GYPSUM BOARD 5/8" THICK UNLESS OTHERWISE INDICATED AND DIMENSIONS NOT SHOWN FOR
- © REFER TO PLUMBING DRAWINGS FOR FIXTURE TYPES AND ADDITIONAL REQUIREMENTS. PROVIDE ADDITIONAL COLD FORM METAL FRAMING OR FIRE TREATED BLOCKING AS REQUIRED FOR PROPER
- D REFER TO INTERIOR FINISH SCHEDULES FOR MATERIAL FINISH TYPES AND LOCATIONS.
- (E) ALL EXPOSED PIPING BELOW SINKS TO BE COVERED WITH INSULATION.

KEY NOTES

- 1) WATER CLOSET. ACCESSIBLE FIXTURE HEIGHT TO TOP OF SEAT TO BE 17" MINIMUM AND 19" MAXIMUM A.F.F.. ACCESSIBLE FIXTURE FLUSH CONTROLS TO BE ON WIDE SIDE OF TOILET.
- 2 WALL HUNG LAVATORY.
- WALL HUNG URINAL. MOUNT RIM 1'-5" MAXIMUM ABOVE FINISH FLOOR.
- 4 HIGH / LOW DRINKING FOUNTAIN WITH CANE GUARD.
- 5 FLOOR MOUNTED JANITOR SINK.

KEY NOTES

- (6) EYE WASH STATION. INSTALL WITH TOP AT 48" ABOVE FINISH FLOOR.
- 7 BASE, REFER TO FINISH SCHEDULE.
- 8 SANITARY WALL PANEL SYSTEM, REFER TO FINISH SCHEDULE. PROVIDE TRIM AND EDGE MOLDING AROUND PERIMETER. ATTACH TO SUBSTRATE AS
- 9 PAINT, REFER TO FINISH SCHEDULE.
- (10) DOOR, REFER TO DOOR AND FINISH SCHEDULES.
- (11) WOOD TRIM, PAINT.
- WALL CONSTRUCTION, REFER TO FLOOR PLAN FOR TYPES.
- 13 FIRE TREATED 2X WOOD BLOCKING.
- WALL OPENING TO BEYOND, REFER TO FLOOR PLAN.
- OWNER FURNISHED AND INSTALLED FURNISHING, SHELVING, OR FIXTURE. FOR REFERENCE ONLY (N.I.C.)
- (16) OWNER FURNISHED AND INSTALLED ACCESSIBLE CUSTOMER SERVICE COUNTER TO COMPLY WITH ACCESSIBILITY REQUIREMENTS. FOR REFERENCE ONLY (N.I.C.)
- WALL MOUNTED WATER HEATER AND SUPPORT PLATFORM, REFER TO PLUMBING DRAWINGS. PROVIDE FIRE TREATED BLOCKING OR ADDITIONAL COLD FORM FRAMING AS REQUIRED FOR INSTALLATION.
- ROOF ACCESS LADDER. SEE FLOOR PLAN AND SHEET



ИK	DESCRIPTION	MANUFACTURER	SERIES / MODEL	MOUNTING LOCATION	ACCESSORY NOTES
\Diamond	TISSUE PAPER DISPENSER	GEORGIA PACIFIC	COMPACT 56783	REFER PLANS, ELEVATIONS, LEGEND	NOTE 2
₿	GRAB BAR	BOBRICK	B6806 x 48"	REFER PLANS, ELEVATIONS, LEGEND	
\$	GRAB BAR	BOBRICK	B6806 x 18"	REFER PLANS, ELEVATIONS, LEGEND	
(D)	GRAB BAR	BOBRICK	B6806 x 36"	REFER PLANS, ELEVATIONS, LEGEND	
€	SANITARY NAPKIN RECEPTACLE	BOBRICK	B-270	REFER PLANS, ELEVATIONS, LEGEND	WOMEN'S RESTROOM ONLY
F	SOAP DISPENSER	GOJO	PRO 2000	REFER PLANS, ELEVATIONS, LEGEND	NOTE 2
(G)	PAPER TOWEL DISPENSER (MEN)	GEORGIA PACIFIC	59460	REFER PLANS, ELEVATIONS, LEGEND	NOTE 2
Œ	PAPER TOWEL DISPENSER (WOMEN)	GEORGIA PACIFIC	SOFPULL 52409	REFER PLANS, ELEVATIONS, LEGEND	NOTE 2
\diamondsuit	MIRROR	BOBRICK	B-165-1836 18" W X 36" H	REFER PLANS, ELEVATIONS, LEGEND	
⟨k⟩	MOP HANGER	REFER TO PLUMBING DRAWINGS	REFER TO PLUMBING DRAWINGS	60" A.F.F. TO CENTER	REFER TO PLUMBING DRAWINGS
Û	DOOR SIGN (MEN)	ROCKWOOD	BF687	REFER PLANS, ELEVATIONS, LEGEND	WHITE TEXT ON BLAC BACKGROUND
₩>	DOOR SIGN (WOMEN)	ROCKWOOD	BF688	REFER PLANS, ELEVATIONS, LEGEND	WHITE TEXT ON BLAC

ACCESSORY GENERAL NOTES


L DOOR SIGN (MEN)


M DOOR SIGN (WOMEN)

. CONTRACTOR TO PROVIDE FIRE TREATED WOOD BLOCKING FOR INSTALLATION OF TOILET ACCESSORIES, INCLUDING OWNER FURNISHED AND CONTRACTOR INSTALLED ACCESSORIES. COORDINATE REQUIREMENTS WITH OWNER.

2. ACCESSORY OWNER FURNISHED AND CONTRACTOR INSTALLED. REFER TO SCOPE OF WORK SCHEDULE FOR ADDITIONAL REQUIREMENTS.

ACCESSORY MOUNTING LEGEND

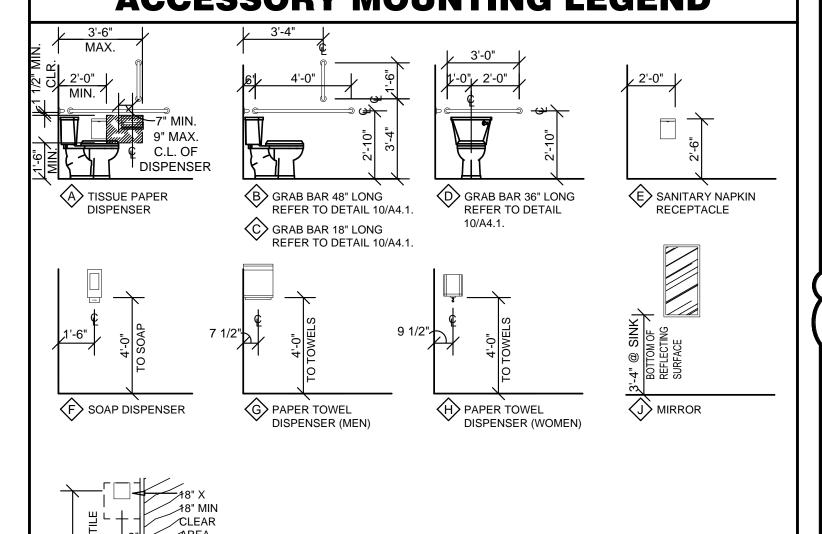




ARCHITECT OF RECORD
ADAM KREHER ARCHITECT LICENSE NUMBER AR98768 SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

HO

KR

JUNE 15, 2018

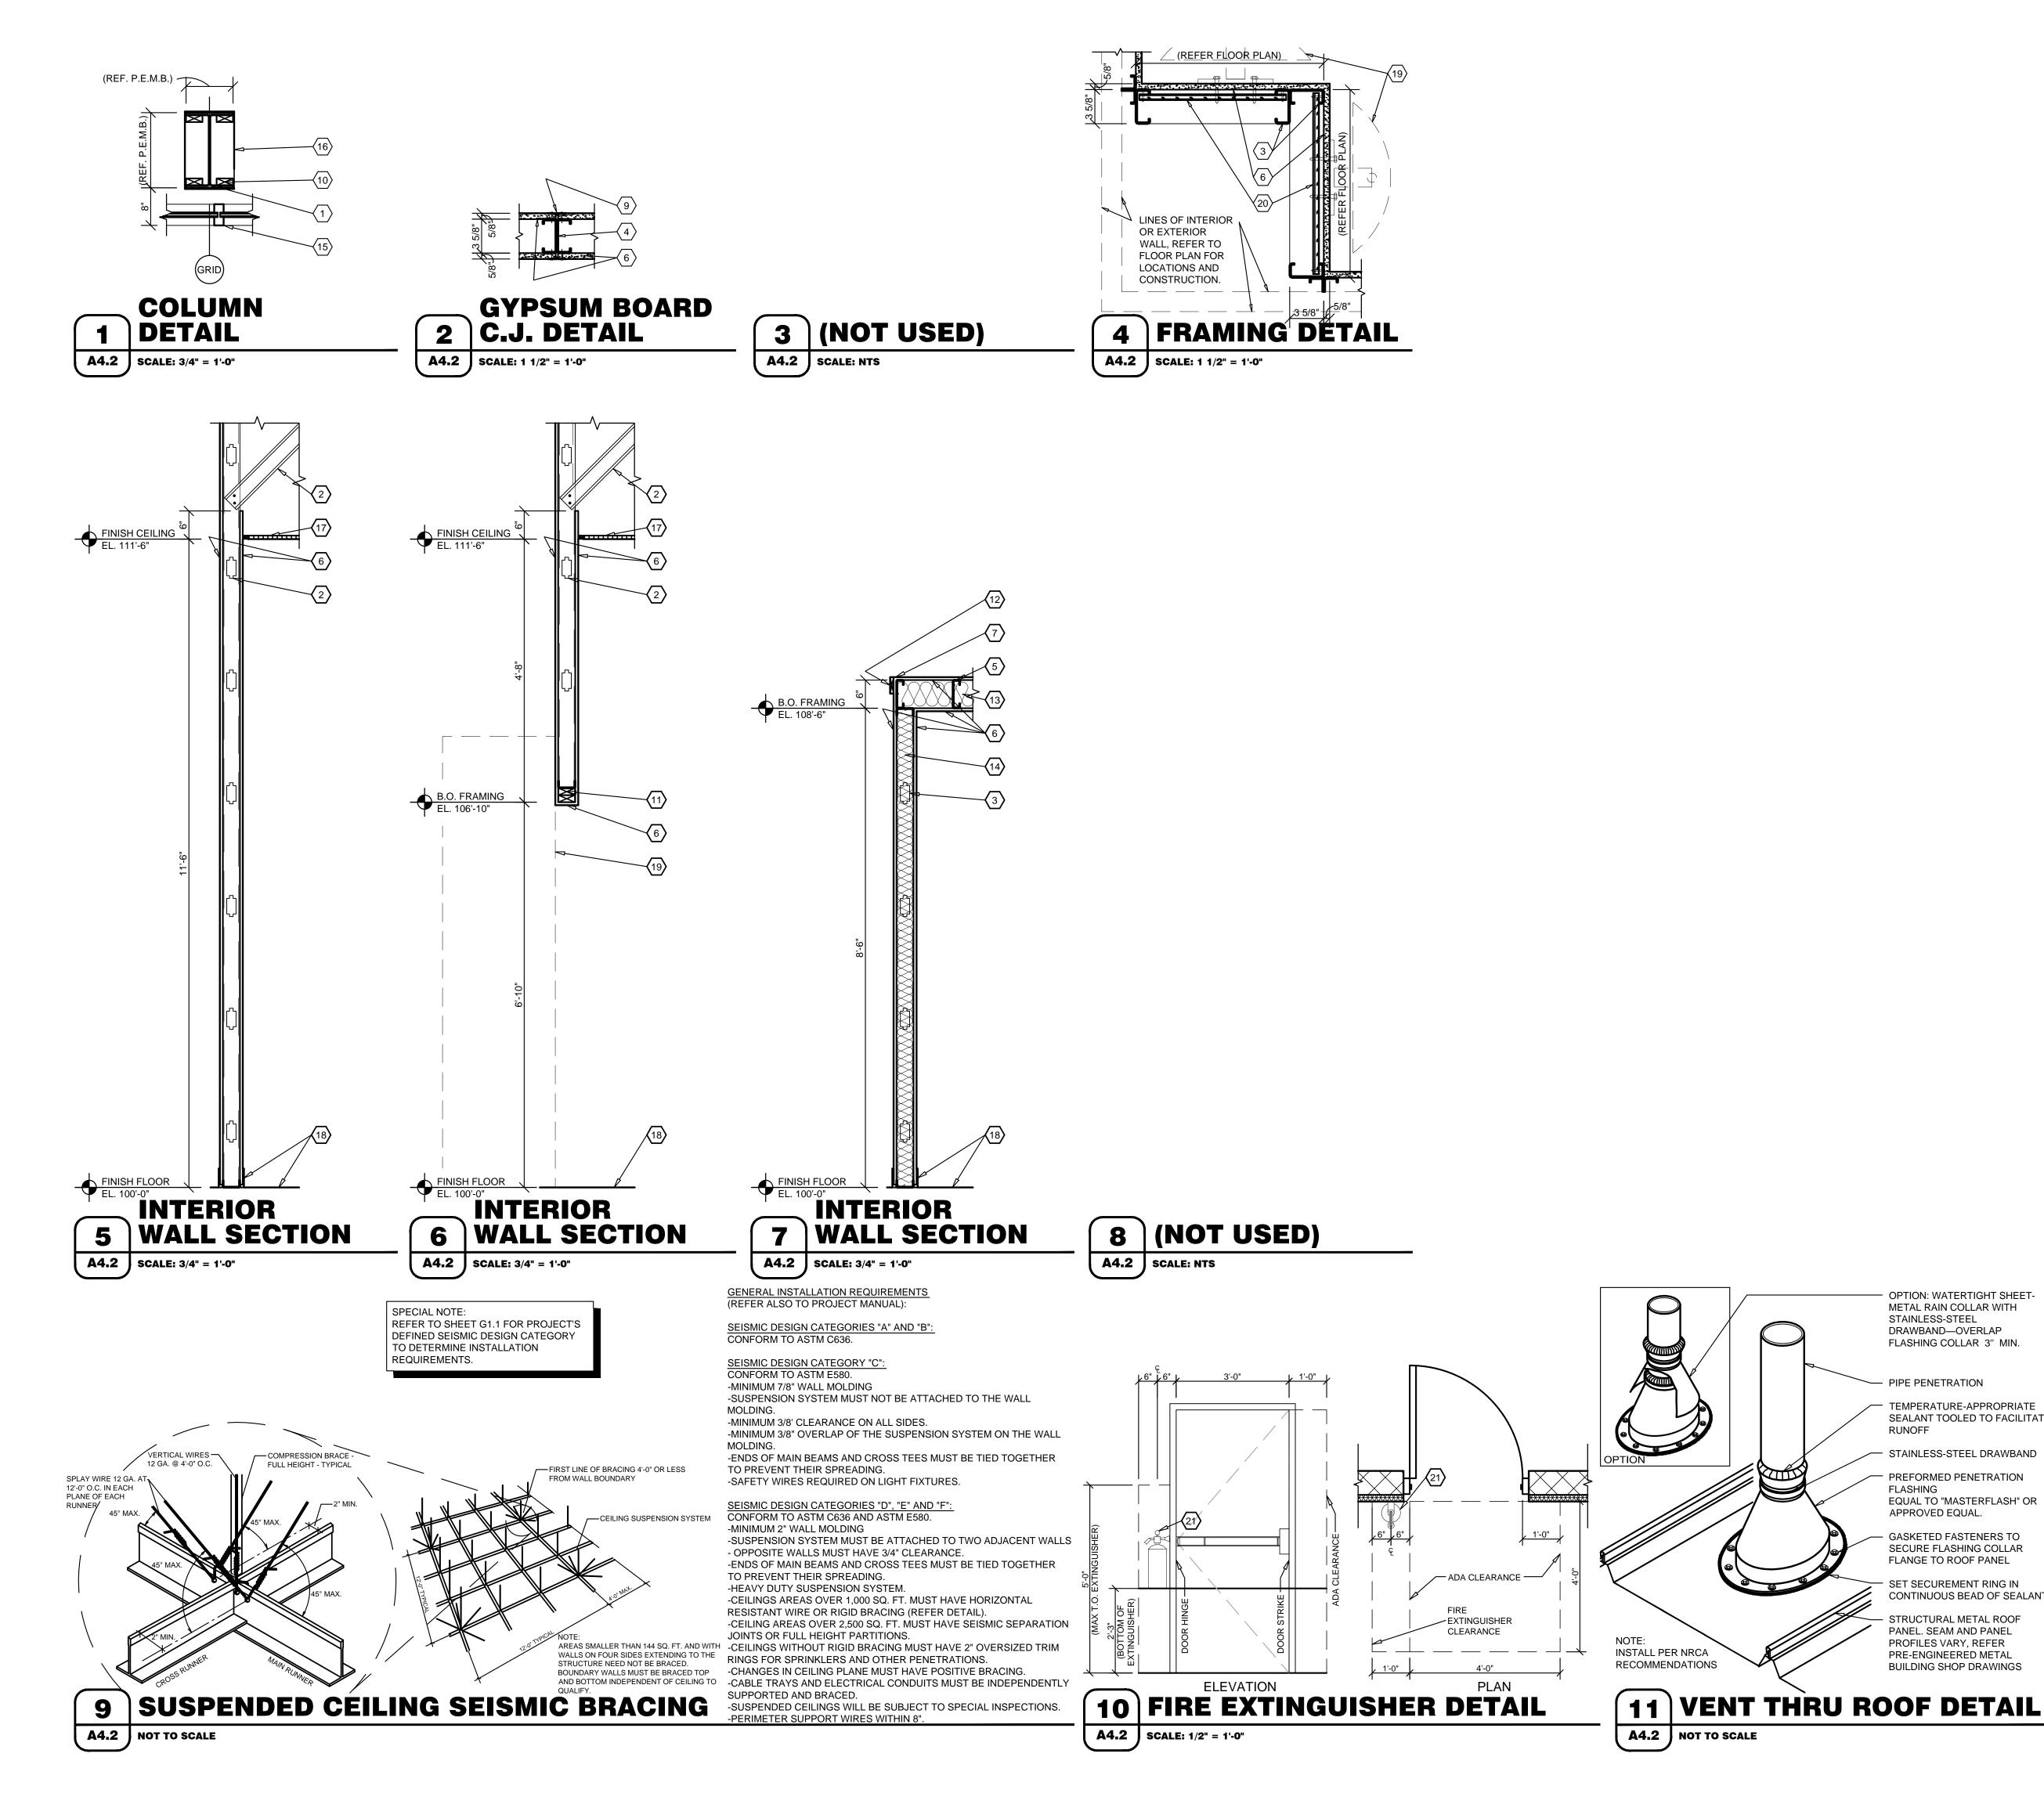

- $\langle A \rangle$ REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.
- (B) DIMENSIONS ARE TO ROUGH FACE OF CONCRETE, MASONRY, FRAMING, OR CENTER LINE OF STRUCTURE UNLESS OTHERWISE
- $\langle \mathtt{C} \rangle$ REFER TO INTERIOR FINISH SCHEDULES FOR MATERIAL TYPES, COLORS AND FINISHES.

KEY NOTES

- \langle 1 \rangle PRE-ENGINEERED METAL BUILDING STRUCTURAL STEEL COLUMN, REFER TO P.E.M.B. SHOP DRAWINGS FOR ADDITIONAL REQUIREMENTS. PAINT (WHERE INDICATED).
- 2 3 5/8" COLD FORM METAL FRAMING ATTACHED TO ROOF STRUCTURE, REFER TO STRUCTURAL DRAWINGS FOR FRAMING REQUIREMENTS.
- 3 5/8" (20 GA.) COLD FORM METAL FRAMING AT 24" O.C., REFER TO INTERIOR WALL TYPES FOR ADDITIONAL REQUIREMENTS.
- $\langle 4 \rangle$ 3 5/8" COLD FORM METAL STUDS DOUBLED AT CONTROL JOINT.
- 5 6" (20 GA.) COLD FORM METAL JOIST FRAMING AT 24" O.C..
- 6 5/8" TYPE "X" GYPSUM BOARD. REFER TO INTERIOR WALL TYPES AND FOR ADDITIONAL REQUIREMENTS.
- $\overline{\langle 7 \rangle}$ GYPSUM BOARD CORNER BEAD CONTINUOUS.
- $\langle 8 \rangle$ (NOT USED)

OPTION: WATERTIGHT SHEET-

METAL RAIN COLLAR WITH

FLASHING COLLAR 3" MIN.

TEMPERATURE-APPROPRIATE SEALANT TOOLED TO FACILITATE

STAINLESS-STEEL DRAWBAND

EQUAL TO "MASTERFLASH" OR

PREFORMED PENETRATION

GASKETED FASTENERS TO

SECURE FLASHING COLLAR

SET SECUREMENT RING IN

- STRUCTURAL METAL ROOF

PANEL. SEAM AND PANEL

PROFILES VARY, REFER

PRE-ENGINEERED METAL

BUILDING SHOP DRAWINGS

CONTINUOUS BEAD OF SEALANT

FLANGE TO ROOF PANEL

APPROVED EQUAL.


DRAWBAND—OVERLAP

STAINLESS-STEEL

PIPE PENETRATION

FLASHING

- (9) GYPSUM BOARD CONTINUES ONE PIECE VEE-SHAPED SLOT CONTROL JOINT (1/4" X 7/16") AT BOTH SIDES OF WALL.
- 10 FIRE TREATED 2X NAILERS OR BLOCKING.
- $\langle 11 \rangle$ (2) FIRE TREATED 2X NAILERS.
- (12) 1X4 WOOD TRIM (PAINT GRADE PINE) ATTACHED TO METAL STUD FRAMING WITH TECH 12 SCREWS AT 24" O.C. SET FLUSH. PAINT EXPOSED SURFACES TO MATCH WALL FINISH.
- $\langle 13 \rangle$ 6" UNFACED SOUND BATT INSULATION.
- (14) 3 1/2" UNFACED SOUND BATT INSULATION.
- (15) ALUMINUM WINDOW SYSTEM, REFER TO FLOOR PLAN AND WINDOW SCHEDULE FOR TYPES.
- PRE-FINISHED SHEET METAL (24 GA.) COLUMN ENCLOSURE TO EXTEND THRU FINISH CEILING SYSTEM. COLOR TO MATCH WINDOW FRAMING FINISH. NO EXPOSED HORIZONTAL SEAMS PERMITTED.
- SUSPENDED ACOUSTICAL CEILING SYSTEM, REFER TO INTERIOR FINISH SCHEDULE FOR TYPES AND LOCATIONS.
- (18) FINISH FLOORING AND BASE, REFER TO INTERIOR FINISH SCHEDULE FOR TYPES AND LOCATIONS.
- (19) OWNER FURNISHED AND INSTALLED FIXTURE, REFER TO INTERIOR FINISH PLAN FOR LAYOUT. (REFER TO SCOPE OF WORK SCHEDULE.
- $\langle 20 \rangle$ 5/8" FIRE TREATED PLYWOOD BACKING TO BACK SIDE OF STUD INTERIOR FLANGE ON EACH EXPOSED WALL FACE FROM 8'-0" TO 10'-0" A.F.F. FOR INSTALLATION OF SECURITY MIRRORS (OWNER FURNISHED
- (21) PORTABLE FIRE EXTINGUISHER MOUNTED AT 42" ABOVE FINISH FLOOR TO CENTERLINE OF EXTINGUISHER. FIRE EXTINGUISHERS SHALL BE UL LISTED ABC TYPE, WITH 10 LBS. CAPACITY. MOUNTING BRACKET QUICK RELEASE TYPE. REFER TO FLOOR PLAN FOR LOCATIONS. PROVIDE BLOCKING AS REQUIRED FOR MOUNTING.



ARCHITECT OF RECORD

ADAM KREHER


SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

NO KR

JUNE 15, 2018


INTERIOR ROOF LADDER SECTION

A4.3 | SCALE: 3/4" = 1'-0"

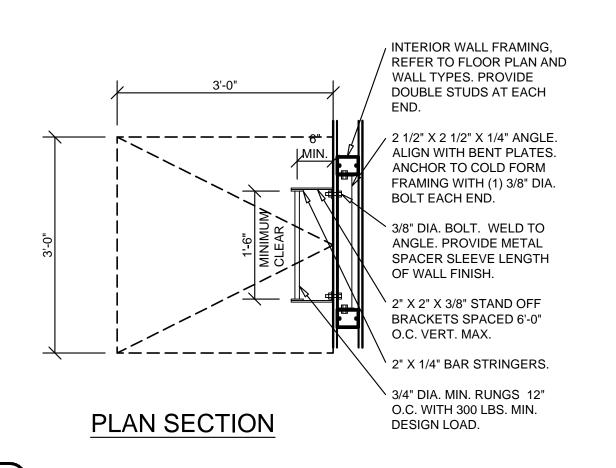

3 INTERIOR ROOF LADDER PLAN SECTION

A4.3 SCALE: 3/4" = 1'-0"

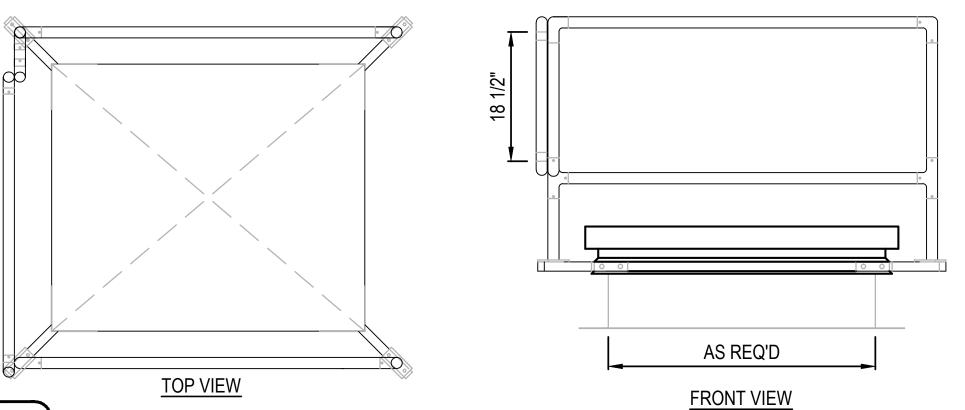

INTERIOR ROOF LADDER SECTION

A4.3 NOT TO SCALE

GENERAL NOTES

A REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.



© REFER TO INTERIOR FINISH SCHEDULES FOR MATERIAL TYPES, COLORS AND FINISHES.

_SELF-CLOSING ___1 1/4" SCH 40


4 7/8" \ |

AS REQ'D

SIDE VIEW

ALUMINUM PIPE

HANDRAILS (6005-T5)



ARCHITECT OF RECORD

ADAM KREHER ARCHITECT LICENSE NUMBER AR98768 SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

SIGN partners

ROOF

AUTO PARTS

NO KR

JUNE 15, 2018

HOLLOW METAL DOOR AND FRAME SYSTEM REFER TO DOOR SCHEDULE. SHIM AND RECOMMENDATIONS. FILL FRAME CAVITY FULL WITH NON-EXPANSIVE FOAM-IN-PLACE INSULATION.


A5.1 | SCALE: 1 1/2" = 1'-0"

HEAD DETAIL

FOR TYPICAL EXTERIOR WALL CONSTRUCTION NOTATION, REFER

HEAD DETAIL

SCALE: 1 1/2" = 1'-0"

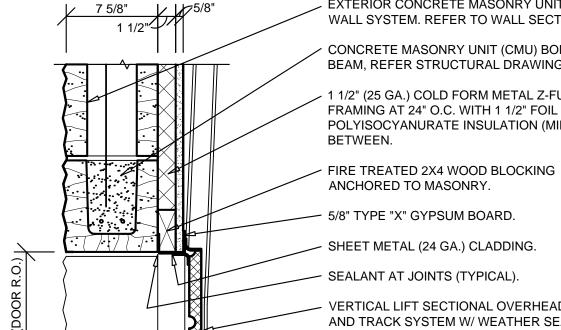

EXTERIOR CONCRETE MASONRY UNIT (CMU) WALL SYSTEM. REFER TO WALL SECTIONS. CONCRETE MASONRY UNIT (CMU) BOND BEAM, REFER STRUCTURAL DRAWINGS.

1 1/2" (25 GA.) COLD FORM METAL Z-FURRING FRAMING AT 24" O.C. WITH 1 1/2" FOIL FACE POLYISOCYANURATE INSULATION (MIN R-9) BETWEEN.

ANCHORED TO MASONRY.


- 5/8" TYPE "X" GYPSUM BOARD. SHEET METAL (24 GA.) CLADDING.

- SEALANT AT JOINTS (TYPICAL).

VERTICAL LIFT SECTIONAL OVERHEAD DOOR AND TRACK SYSTEM W/ WEATHER SEALS, REFER TO DOOR SCHEDULE. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE ADDITIONAL METAL FRAMING OR FIRE TREATED BLOCKING AS REQUIRED FOR

HEAD DETAIL


A5.1 SCALE: 1 1/2" = 1'-0"

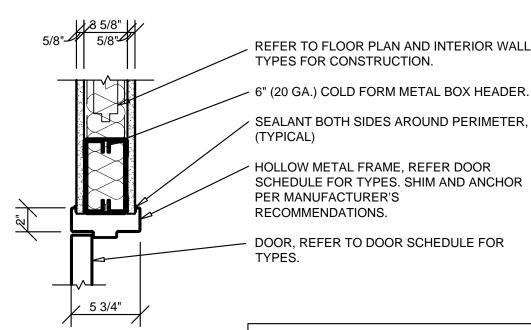

SPECIAL NOTE: UNLESS OTHERWISE INDICATED, KNOCK DOWN (KD) TYPE DOOR FRAMES ARE NOT

HEAD DETAIL

A5.1 | SCALE: 1 1/2" = 1'-0"

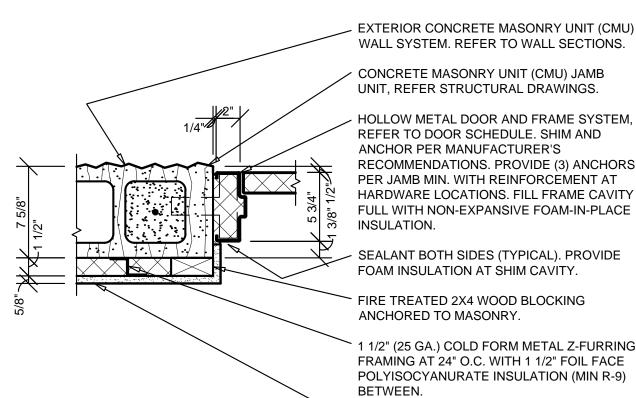

CONCRETE MASONRY UNIT (CMU) JAMB UNIT, REFER STRUCTURAL DRAWINGS.

WALL SYSTEM. REFER TO WALL SECTIONS.

HOLLOW METAL DOOR AND FRAME SYSTEM, REFER TO DOOR SCHEDULE. SHIM AND ANCHOR PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE (3) ANCHORS PER JAMB MIN. WITH REINFORCEMENT AT HARDWARE LOCATIONS. FILL FRAME CAVITY FULL WITH NON-EXPANSIVE FOAM-IN-PLACE

SEALANT BOTH SIDES (TYPICAL). PROVIDE FOAM INSULATION AT SHIM CAVITY.

FIRE TREATED 2X4 WOOD BLOCKING ANCHORED TO MASONRY.

1 1/2" (25 GA.) COLD FORM METAL Z-FURRING FRAMING AT 24" O.C. WITH 1 1/2" FOIL FACE POLYISOCYANURATE INSULATION (MIN R-9)

5/8" TYPE "X" GYPSUM BOARD.


JAMB DETAIL

SCALE: 1 1/2" = 1'-0"

FOR TYPICAL EXTERIOR WALL CONSTRUCTION NOTATION, REFER

JAMB DETAIL


SCALE: 1 1/2" = 1'-0"

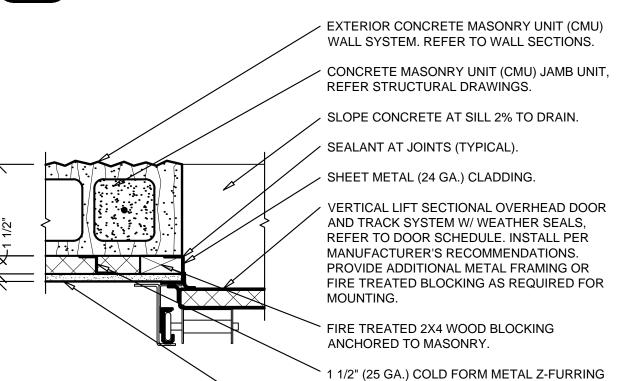

FRAMING AT 24" O.C. WITH 1 1/2" FOIL FACE POLYISOCYANURATE INSULATION (MIN R-9)

5/8" TYPE "X" GYPSUM BOARD. **JAMB DETAIL**

SCALE: 1 1/2" = 1'-0"

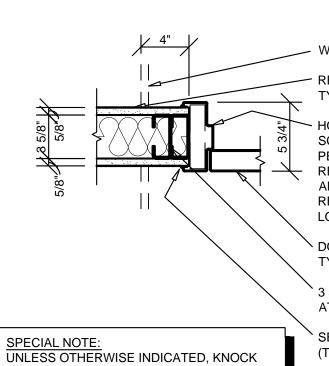

WALL (WHERE OCCURS). REFER TO FLOOR PLAN AND INTERIOR WALL TYPES FOR CONSTRUCTION. HOLLOW METAL FRAME, REFER DOOR

SCHEDULE FOR TYPES. SHIM AND ANCHOR PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE (3) ANCHORS PER JAMB MIN. WITH REINFORCEMENT AT HARDWARE LOCATIONS.

DOOR, REFER TO DOOR SCHEDULE FOR

3 5/8" (20 GA.) COLD FORM METAL FRAMING AT 24" O.C.. DOUBLE STUDS AT JAMBS.

SEALANT BOTH SIDES AROUND PERIMETER, (TYPICAL).

JAMB DETAIL

SCALE: 1 1/2" = 1'-0"

DOWN (KD) TYPE DOOR FRAMES ARE NOT

DOOR SCHEDULE

MK			DOOR	DOOR HARDWARE		FRAME			DETAILS			FIRE	REMARKS (REFER		
	SIZE (W x H x D)	TYPE	SWING	MATERIAL	GLAZ. TYPE	SET #	KEYED	TYPE	MATERIAL	HEAD WIDTH	HEAD	JAMB	SILL	RATING	NOTES)
1	3'-0" X 7'-0" X 1-3/4"	Α	REFER TO FLOOR PLAN	ALUMINUM	1	1	Α	1	ALUMINUM		4/A5.2	4/A5.2	5/A5.2		1, 2
2	3'-0" X 7'-0" X 1-3/4	В	REFER TO FLOOR PLAN	INSULATED METAL		2	А	2	INSULATED METAL		1/A5.1	2/A5.1	5/A5.2 SIM.		1, 2, 3
3	6'-0" X 8'-0"	D	SECTIONAL OVERHEAD	INSULATED METAL		3			UFACTURER'S TANDARDS		5/A5.1	6/A5.1			1
4	3'-0" X 7'-0" X 1-3/4"	С	REFER TO FLOOR PLAN	SOLID WOOD		4		2	HOLLOW METAL		7/A5.1	8/A5.1			1, 4
5	3'-0" X 7'-0" X 1-3/4"	С	REFER TO FLOOR PLAN	SOLID WOOD		5		2	HOLLOW METAL		7/A5.1	8/A5.1			1, 4
6	3'-0" X 7'-0" X 1-3/4"	С	REFER TO FLOOR PLAN	SOLID WOOD		5		2	HOLLOW METAL		7/A5.1	8/A5.1			1, 4
7	3'-0" X 7'-0" X 1-3/4"	В	REFER TO FLOOR PLAN	INSULATED METAL		6		2	INSULATED METAL		3/A5.1	4/A5.1	5/A5.2 SIM.		1, 3

ALL DOORS SHALL BE SHOP PREPARED FOR HARDWARE.

2. ALL EXTERIOR DOORS TO BE KEYED ALIKE. CONTRACTOR TO FIELD VERIFY AND MATCH CORE OF DOOR MARKED "2" 3. EXTERIOR DOOR, FRAME AND HARDWARE OWNER FURNISHED AND CONTRACTOR INSTALLED. REFER TO SCOPE OF WORK SCHEDULE.

4. CONTRACTOR'S OPTION TO PURCHASE INTERIOR DOORS, FRAMES, AND HARDWARE THROUGH PREFERRED VENDOR. REFER TO SCOPE OF WORK SCHEDULE.

LOCKNET 100 COURCHELLE DRIVE NICHOLASVILLE, KY 40356 CONTACT: PAM PEEL


PHONE 800-887-4307 EXT 133 FAX 859-881-5499 EMAIL: construction@locknet.com

(REFER TO SCHEDULES FOR


UNLESS OTHERWISE INDICATED, KNOCK DOWN (KD) TYPE DOOR FRAMES ARE NOT PERMITTED.


DOOR TYPES

(SCALE 1/4" = 1'-0")

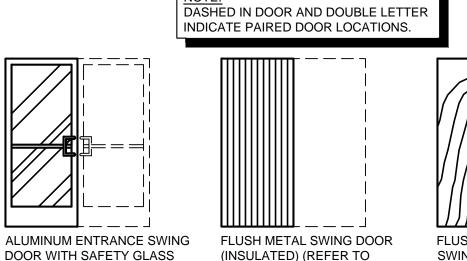

FLUSH SOLID CORE WOOD (INSULATED) (REFER TO SWING DOOR (REFER TO SCHEDULES FOR FINISHES) SCHEDULES FOR FINISHES)






SECTIONAL OVERHEAD DOOR (INSULATED) WITH VERTICAL LIFT CLEARANCE TRACK SYSTEM MOUNTED AT 11'-0" MAXIMUM A.F.F.. MANUAL OPERATION WITH PULL ROPE. (REFER TO SCHEDULES FOR FINISHES)

FRAME TYPES

(SCALE 3" = 1'-0")

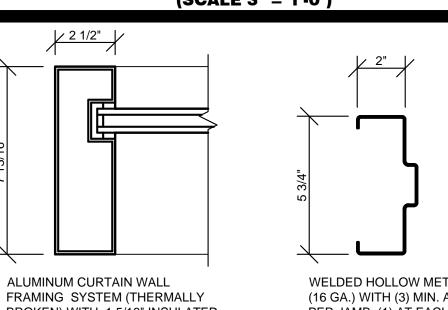

BROKEN) WITH 15/16" INSULATED GLAZING.

REFER TO EXTERIOR FINISH SCHEDULES FOR FRAME COLORS AND GLAZING SCHEDULE FOR GLAZING TYPES.

WELDED HOLLOW METAL FRAME (16 GA.) WITH (3) MIN. ANCHORS PER JAMB, (1) AT EACH JAMB SILL, AND ADDITIONAL ANCHORS AT HARDWARE LOCATIONS.

REFER EXTERIOR AND INTERIOR FINISH SCHEDULES FOR COLORS.

DOOR HARDWARE SCHEDULE

HARDWARE NOTES

1. ALL HARDWARE TO BE ADA AND ANSI COMPLIANT

2. VERIFY COMPATIBILITY OF HARDWARE SPECIFIED. NOTIFY ARCHITECT OF INCOMPATIBILITY ISSUES PRIOR TO ORDERING AND INSTALLATION.

SET NO. 1 (DR. 1)
1 CYLINDER: 20-062 X US26D - "E" KEYWAY (REMOVABLE CORE).. SCHLAGE (FOLLOWING REQUIRED HARDWARE FURNISHED WITH WINDOW FRAMING DOOR SYSTEM) 1 PAIR OFFSET PIVOTS: 195/188 X US26D 1 DEADLOCK: MS1850S X US28.. ADAMS RITE 1 DEADLOCK LEVER: 4550 X US28. ADAMS RITE 1 STRIKE: MS4002 X US28.. ADAMS RITE SET PUSH/PULLS: 86-151 ULTRALINE W/ OFFSET PULL X US26D... **EFCO** 1 CLOSER: 4041-3077-18TJ-TB X AL (ADJ. TO 8.5 LBS.).. LCN 1 SET PERIMETER GASKETS: POLYMERIC BULB X LENGTH REQUIRED... ... PEMKO 1 SWEEP: 345AP X LENGTH REQUIRED.. PEMKO 1 THRESHOLD: 270A X LENGTH REQUIRED (OFFSET PIVOT COMPATIBLE) (ANSI & ADA COMPLIANT).. . PEMKO

SET NO. 2 (DR. 2)
1 CONTINUOUS HINGE: 780-112HD X LENGTH REQUIRED X US28... HAGER 1 CYLINDER: 20-057 X US26D - "E" KEYWAY (REMOVABLE CORE) PROVIDE (2) SECURITY KEYS, (1) CORE KEY, (1) BITTED. ..SCHLAGE EXIT PANIC LOCK: 9300B X 486 X 689 - PRT03 X 630 (THROUGH SEX BOLT MOUNTING).. .. DORMA CLOSER: 8616DST X COV X SNB1 X 689 (ADJ. TO 8.5 LBS.) (THROUGH SEX BOLT MOUNTING)... DORMA

SET PERIMETER GASKETS: JAMBS - KERFED QEBD-500, HEADER **SCHLEGEL** LATCH GUARD: LG100Z/SF X US26D (STRAIGHT W/ PIN W/ SEX BOLTS) . LATCHGUARD DOOR VIEWER: 698 - 190 DEGREE WIDE ANGLE X US26D.. IVES HAGAR KICK PLATE: 190S X 8" X 34" X US32D. SWEEP: 345AP X LENGTH REQUIRED.. PEMKO THRESHOLD: 271A X LENGTH REQUIRED. PEMKO

REQUIRED HARDWARE FURNISHED WITH OVERHEAD DOOR SYSTEM (LOCKING FROM INSIDE ONLY)

HINGES: BB1279 X 4 1/2" X 4 1/2" X US26D. HAGER OFFICE LOCK: AU5307LN X US26D.. YALE 1 WALL BUMPER: 409 X US26D. ROCKWOOD SET NO. 5 (DR. 5, 6)

HINGES: BB1279 X 4 1/2" X 4 1/2" X US26D. HAGER PRIVACY LOCK: AU5302LN X US26D.. ...YALE 1 WALL BUMPER: 409 X US26D. ROCKWOOD <u>SET NO. 6 (DR. 7)</u> 3 HINGES: ECBB1100 X 4 1/2" X 4 1/2" X US32D X NRP.

HAGER 1 EXIT ONLY PANIC LOCK: 8300B X 486 X 689. DORMA 1 CLOSER: 5300MLT X ALM (ADJ. TO 8.5 LBS.) (THROUGH SEX BOLT MOUNTING)... HAGER 1 SET PERIMETER GASKETS: JAMBS - KERFED QEBD-500, HEADER ADHESIVE QDST-675... **SCHLEGEL** 1 LATCH GUARD: LG100Z/SF X US26D (STRAIGHT W/ PIN W/ SEX BOLTS) .. LATCHGUARD 1 SWEEP: 345AP X LENGTH REQUIRED.. PEMKO

GENERAL NOTES

A REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.

1 THRESHOLD: 271A X LENGTH REQUIRED.

B REFER TO BUILDING CODE SUMMARY FOR PROJECT STRUCTURAL DESIGN CRITERIA DOOR FRAMING AND ANCHORING SYSTEMS SHALL BE DESIGNED BY MANUFACTURER TO CONFORM TO PERFORMANCE AND TESTING REQUIREMENTS SPECIFIED.

© REFER TO FLOOR PLAN, ELEVATIONS, AND SECTIONS FOR ADDITIONAL

D REFER TO EXTERIOR AND INTERIOR FINISH SCHEDULES FOR COLORS. PERIMETER SEALANT COLOR TO MATCH FRAME COLOR UNLESS OTHERWISE INDICATED.

ADAM KREHER

SHEETS BEARING THIS SEAL ARE ITHENTICATED, RESPONSIBILITY FOR L OTHER PLANS, SPECIFICATIONS


SIGN partners

THE STATE OF THE S

NO KR **JUNE 15, 2018**

PROJECT NUMBER:

18078-OF4

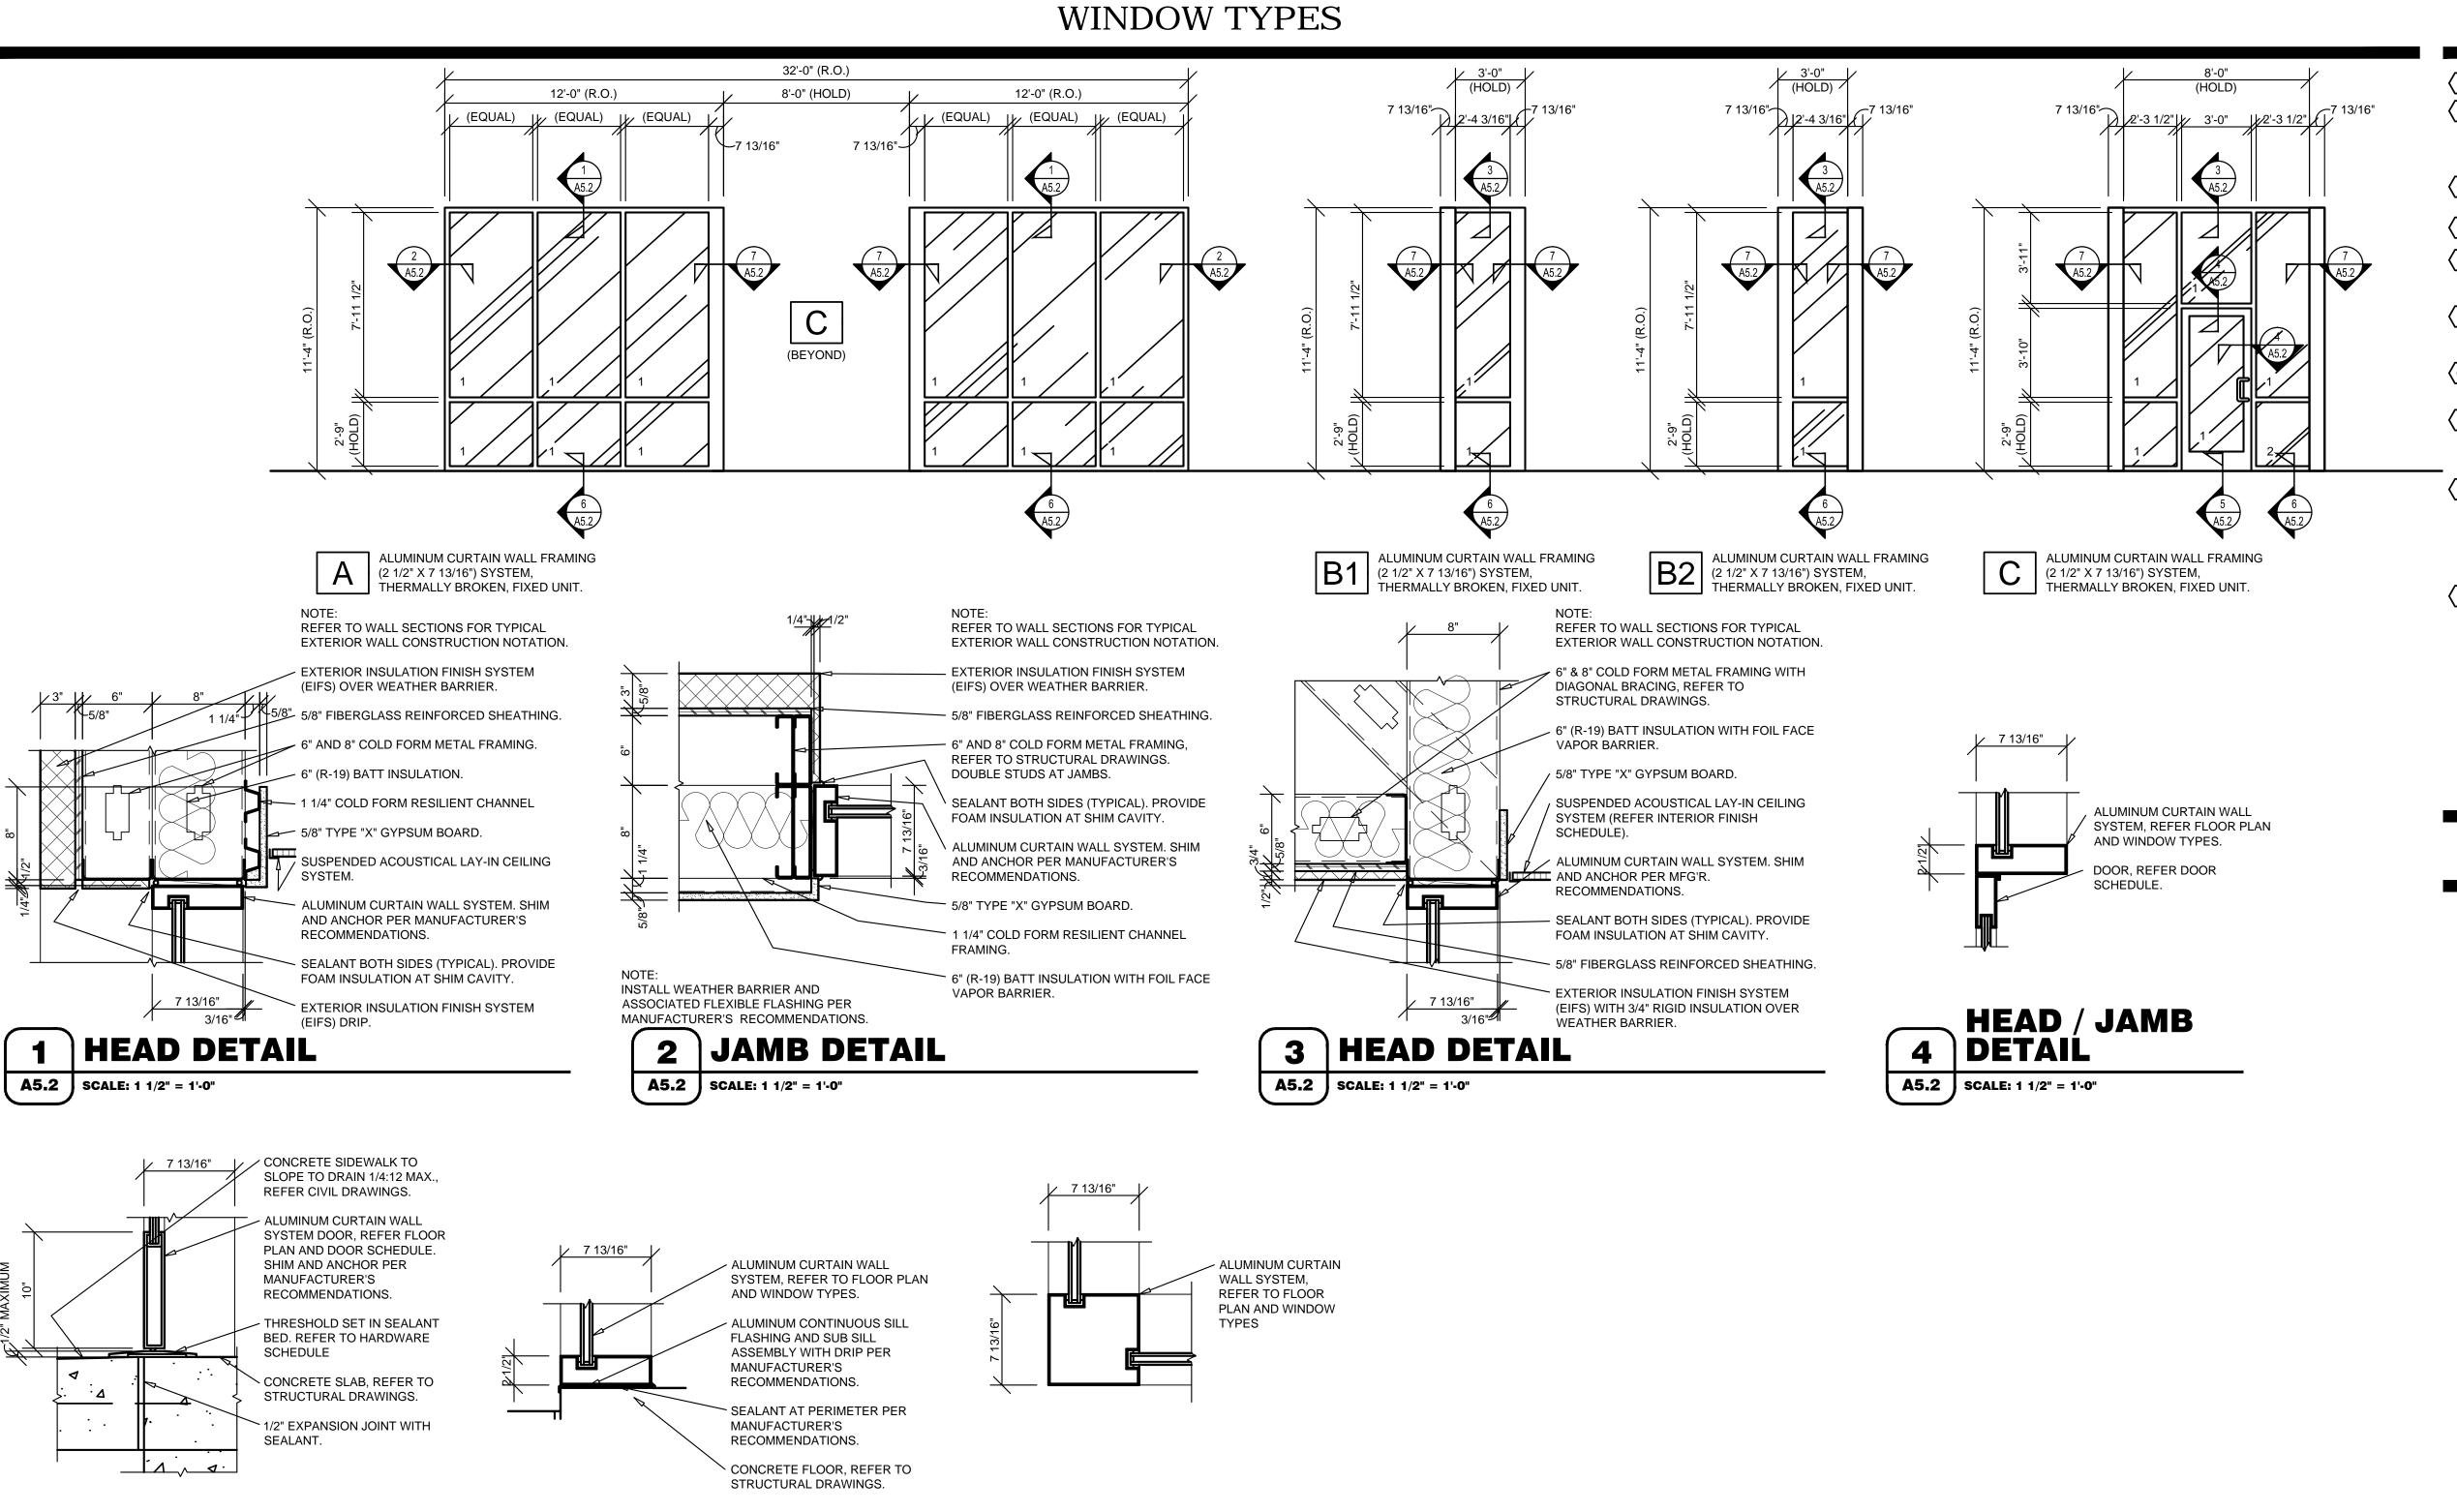

JAMB DETAIL

SCALE: 1 1/2" = 1'-0"

A5.2

5 SILL DETAIL

A5.2 | SCALE: 1 1/2" = 1'-0"

6 SILL DETAIL

SCALE: 1 1/2" = 1'-0"

A5.2

GENERAL NOTES

(A) REFER TO PROJECT MANUAL FOR ADDITIONAL REQUIREMENTS.

B REFER TO BUILDING CODE SUMMARY FOR PROJECT STRUCTURAL DESIGN CRITERIA. WINDOW FRAMING AND ANCHORING SYSTEMS SHALL BE DESIGNED BY MANUFACTURER TO CONFORM TO

PERFORMANCE AND TESTING REQUIREMENTS SPECIFIED. REFER TO FLOOR PLAN, ELEVATIONS, AND SECTIONS FOR ADDITIONAL REQUIREMENTS.

D WINDOW TYPE ELEVATIONS SHOWN VIEWED FROM EXTERIOR SIDE.

REFER TO EXTERIOR FINISH SCHEDULES FOR ALUMINUM WINDOW FRAMING COLORS. PERIMETER SEALANT COLOR TO MATCH WINDOW FRAMING COLOR UNLESS OTHERWISE INDICATED.

F ALL DIMENSIONS TO ROUGH FACE OF FRAMING UNLESS OTHERWISE INDICATED. FIELD VERIFY FINAL ROUGH OPENINGS PRIOR TO FABRICATION.

G REFER TO DOOR AND HARDWARE SCHEDULES FOR ADDITIONAL REQUIREMENTS.

(H) SECURITY SHUTTERS MAY BE REQUIRED. CONTACT PROJECT ADMINISTRATOR FOR VERIFICATION. (REFER TO SCOPE OF WORK SCHEDULE). PROVIDE ADDITIONAL SUPPORT FRAMING SYSTEM AS

(I) WHEN WIND SPEED IS EQUAL TO OR GREATER THAN 120 MPH, A STORM PANEL SYSTEM SHALL BE OWNER FURNISHED AND INSTALLED. CONTACT PROJECT ADMINISTRATOR TO VERIFY AND COORDINATE WITH SYSTEM PROVIDED BY OTHERS. (REFER TO SCOPE OF WORK SCHEDULE). PROVIDE ADDITIONAL SUPPORT FRAMING SYSTEM AS REQUIRED.

 $\langle J \rangle$ CONTRACTOR'S OPTION TO DIRECT ORDER AND PURCHASE WINDOW FRAMING SYSTEM AND GLAZING FROM THE FOLLOWING SUPPLIER (REFER TO SCOPE OF WORK SCHEDULE):

COULTER & COMPANY 13711 E. 66TH ST. N. OWASSO, OK 74055 PHONE: (918) 272-4494 FAX: (918) 272-7908 EMAIL: carl@coulterglass.com CONTACT: Carl Yorman

GLAZING SCHEDULE

1 5/16" INSULATED IMPACT RESISTANT SAFETY GLAZING (7/16" VITRO "SOLEXIA" TEMPERED EXTERIOR PANE WITH REINFORCING INNER LAYER / 7/16" CLEAR TEMPERED INTERIOR SHGC TO EQUAL 0.25 OR GREATER

U-FACTOR TO EQUAL 0.50 OR GREATER

ARCHITECT OF RECORD


ADAM KREHER ARCHITECT LICENSE NUMBER AR98768 SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED.

AUTO PARTS

KR


JUNE 15, 2018 REVISION:

NO

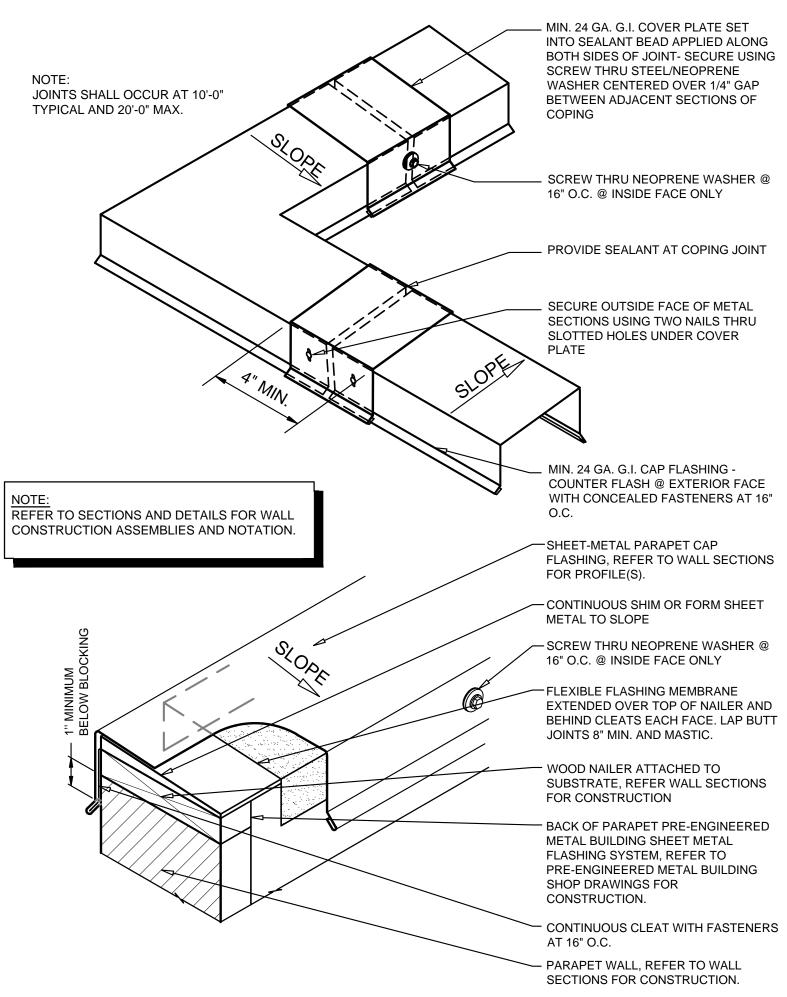

A6.1 | SCALE: N.T.S.

NOT USED

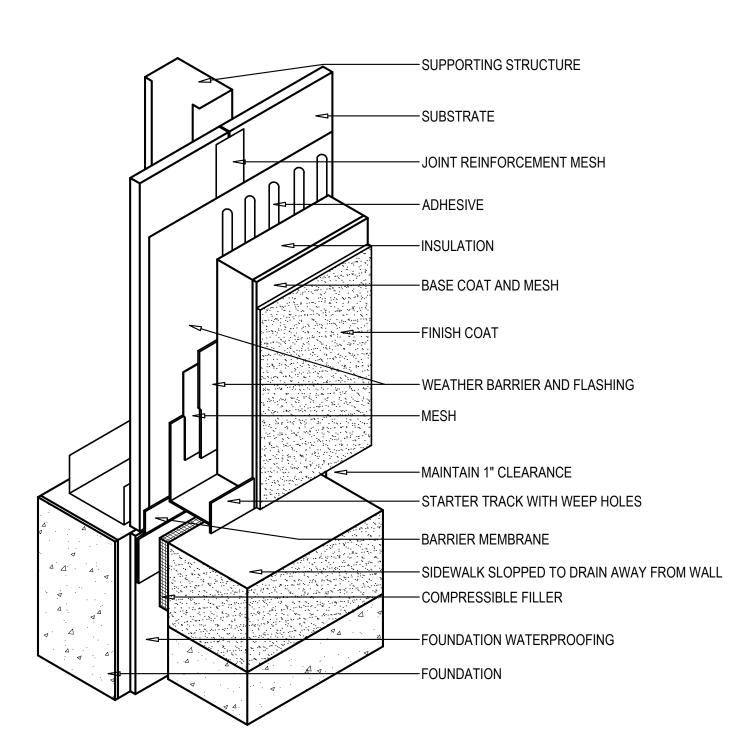


NOTE:
REFER TO SECTIONS AND DETAILS FOR WALL CONSTRUCTION ASSEMBLIES AND NOTATION.

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

EIFS TERMINATION DETAIL

A6.1 SCALE: N.T.S.

2 TYPICAL COPING FLASHING DETAIL A6.1 SCALE: N.T.S.

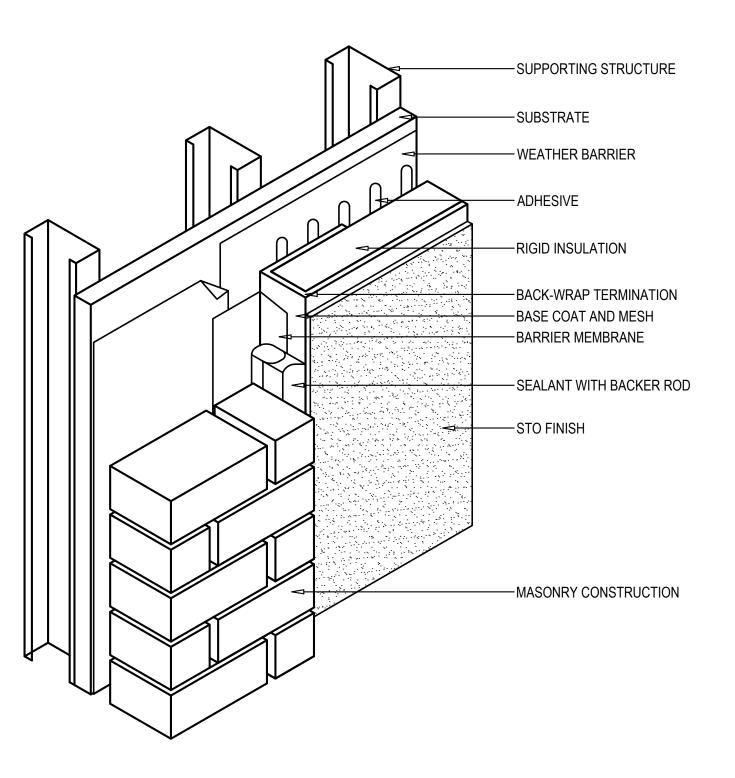

NOTE:
REFER TO SECTIONS AND DETAILS FOR WALL CONSTRUCTION ASSEMBLIES AND NOTATION.

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

EIFS TERMINATION DETAIL

A6.1 SCALE: N.T.S.

GENERAL NOTES

- (A) REFER TO PROJECT MANUAL AND SCOPE OF WORK SCHEDULE FOR ADDITIONAL REQUIREMENTS.
- B SHEET METAL AND ROOFING CONSTRUCTION SHALL COMPLY WITH NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA) AND SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION (SMACNA) DESIGN STANDARDS AND RECOMMENDATIONS.



ARCHITECT OF RECORD

ADAM KREHER ARCHITECT LICENSE NUMBER
AR98768

SHEETS BEARING THIS SEAL ARE AUTHENTICATED, RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS OR INSTRUMENTS ARE DISCLAIMED. SIGN partners

AUTO PARTS

NO **JUNE 15, 2018**

PROJECT NUMBER: 18078-OF4

SUBSTRATE WEATHER BARRIER **ADHESIVE** RIGID INSULATION BOARD REINFORCING MESH BASE COAT MESH OVERLAPED 2 1/2" - DRYVIT BASE COAT FINISH COAT REFER TO SECTIONS AND DETAILS FOR WALL CONSTRUCTION ASSEMBLIES AND NOTATION.

NOTES:

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.

3 EIFS DECORATIVE JOINT DETAIL

A6.1 SCALE: N.T.S.